

Technical manual

LioN-P EtherNet/IP IO-Link Master

0980 ESL 199-121

0980 ESL 199-122

0980 ESL 199-331

0980 ESL 199-332

0980 ESL 398-121

0980 ESL 399-121



Contents

1	About this manual	9
1.1	General information	9
1.2	Explanation of symbols	10
1.2.1	Use of danger information	10
1.2.2	Use of general information	10
1.3	Version information	11
1.4	Designations and synonyms	11
2	Safety instructions	13
2.1	Intended use	13
2.2	Qualified personnel	14
3	System description	15
3.1	About the LioN-P module series	15
3.2	Special product features	15
3.3	EtherNet/IP product features	16
3.2	I/O port features	15
3.5	Integrated web server	19
3.6	Other features	20
3.7	Product overview	20
4	Assembly and wiring	23
4.1	General information	23
4.2	Outer dimensions	25
4.2.1	Module 0980 ESL 398-121 & ESL 399-121	25
4.2.2	Module 0980 ESL 199-121	26
4.2.3	Module 0980 ESL 199-332	27
4.2.4	Module 0980 ESL 199-122	28
4.2.5	Module 0980 ESL 199-331	29
4.3	Port assignments	30
4.3.1	Ethernet ports	30
4.3.2	Power supply with M12 power L-coded	31
4.3.3	EtherNet/IP and power supply with M12 Hybrid	32

4.3.4	I/O ports as M8 or M12 sockets	33
5	Starting operation	35
5.1	Downloading and installing the EDS file	35
5.2	Reading the MAC addresses	35
5.3	Setting the network parameters	36
5.4	Configuration of the device with RsLogix 5000	37
6	Parameter of the IO-Link Master	41
6.1	General Device Settings	41
6.2	Global diagnosis parameter	42
6.3	Failsafe parameter for digital outputs	43
6.4	Surveillance timeout parameter, LioN-P 60	45
6.5	Digital input logic	46
6.6	Digital I/O mode channel B, LioN-P 60	48
6.7	IO-Link port mode parameter (channel A)	49
6.8	IO-Link port extended parameter	52
7	Connections	59
7.1	Exclusive Owner Connections	59
7.2	Listen Only Connections	62
8	Bit assignment	63
8.1	Status data of IO-Link Master (inputs)	63
8.1.1	Status of digital inputs (mapping 1, default)	63
8.1.2	Status of digital inputs (mapping 2)	64
8.1.3	Status of IO-Link communication	65
8.1.4	Status of IO-Link process data validity	65
8.1.5	Status of module diagnostic	66
8.1.6	Status of sensor supply diagnostic	66
8.1.7	Reserved (byte 7)	66
8.1.8	Status of digital output diagnostic	67
8.1.9	Status of module diagnostic	67
8.2	IO-Link Device input data	68
8.2.1	IO-Link data for 4 byte input, assembly 103	69
8.2.2	IO-Link data for 8 byte input, assembly 105	69
8.2.3	IO-Link data for 16 byte input, assembly 107	70

8.2.4	IO-Link data for 32 byte input, assembly	109	70
8.3	IO-Link input & extended IO-Link status data		71
8.3.1	IO-Link 4 byte input & ext. status, assembly	111	72
8.3.2	IO-Link 8 byte input & ext. status, assembly	113	72
8.3.3	IO-Link 16 byte input & ext. status, assembly	115	73
8.3.4	IO-Link 32 byte input & ext. status, assembly	117	74
8.4	IO-Link input & ext. IO-Link status & IO-Link event		75
8.4.1	IO-L 4 byte & status & event data, assembly	119	78
8.4.2	IO-L 8 byte & status & event data, assembly	121	79
8.4.3	IO-L 16 byte & status & event data, assembly	123	80
8.4.4	IO-L 32 byte & status & event data, assembly	125	81
8.5	Control data of IO-Link Master (outputs)		82
8.5.1	Control of digital outputs (mapping 1, default)		
	Exclusion: 0980 ESL 3x8-121		82
8.5.2	Control of digital outputs (mapping 2, E2C-comp.)		
	Exclusion: 0980 ESL 3x8-121		83
8.5.3	Control of digital outputs for 0980 ESL 3x8-121 (mapping 1, default)		83
8.5.4	Control of digital outputs for 0980 ESL 3x8-121 (mapping 2)		84
8.5.5	Control of IO-Link COM mode		84
8.5.6	Reserved		85
8.6	Control data of IO-Link Device (outputs)		85
8.6.1	IO-Link Device 4 byte output, assembly	102	85
8.6.2	IO-Link Device 8 byte output, assembly	104	85
8.6.3	IO-Link Device 8 byte output, assembly	104	86
8.6.4	IO-Link Device 32 byte output, assembly	108	86
9	Diagnostics processing		87
9.1	Error in the system/sensor power supply		87
9.2	Error in auxiliary/actuator power supply		88
9.3	Overload/short-circuit of the I/O port sensor supply outputs		89
9.4	Overload/short circuit of the digital 500 mA outputs		89
9.5	Overload/short circuit of the digital 2.0 A outputs		90
9.6	Overload/short circuit of the type B port aux. power supply		91
9.6.1	For LioN-P 30 devices		91
9.6.2	For LioN-P 60 devices		92
9.7	IO-Link Master error		92
9.7.1	IO-Link C/Q error		92

9.7.2	IO-Link validation error	93
9.8	IO-Link device diagnostics	93
9.8.1	IO-Link Device error	93
9.8.2	IO-Link Device warning	94
9.8.3	IO-Link Device warning	94
10	EtherNet/IP objects	95
10.1	IO-Link Device parameter object (Class Code 0x80)	95
10.1.1	Read ISDU service (Class Code 0x80)	95
10.1.2	Write ISDU service (Class Code 0x80)	96
10.2	IO-Link failsafe parameter Object (Class-Code 0x81)	97
10.2.1	Set failsafe parameter (Class Code 0x81)	98
10.2.2	Get failsafe parameter (Class Code 0x81)	98
11	The integrated web server	99
11.1	The Status page	100
11.2	The Ports page	102
11.3	The System page	103
11.4	The User page	105
12	Technical data	107
12.1	General	107
12.2	EtherNet/IP protocol	108
12.3	Power supply for the module electronics/sensors	109
12.4	Power supply type B ports (auxiliary supply)	109
12.5	IO-Link Master Ports (X1-X8, Channel A)	110
12.5.1	Configured as a digital input	110
12.5.2	Configured as a digital output (except 0980 ESL 3x8-121)	110

12.5.3 Configured as an IO-Link port in COM mode	111
12.6 Digital inputs (X1 – X4, type A ports, ch. B)	111
12.7 LioN-P 60: Auxiliary power supply as digital output (X5 - X8, Type B / Ch. B)	112
12.8 LEDs	113
13 Accessories	115

1 About this manual

1.1 General information

Please read the assembly and operating instructions in this manual carefully before starting up the LioN-P modules with EtherNet/IP interface. Keep the manual where it is accessible to all users.

The texts, figures, diagrams, and examples used in this manual are used exclusively to explain how to operate and apply the LioN-P modules with EtherNet/IP interface.

Please contact us if you have any detailed questions on installing and starting up the devices. We will be happy to help you.

Belden Deutschland GmbH
– Lumberg Automation™ –
Im Gewerbepark 2
58579 Schalksmühle
Germany
Tel. +49 (0) 23 55 / 5044-0
Fax +49 (0) 23 55 / 5044-333
support-automation@belden.com
www.lumberg-automation.com

Belden Deutschland GmbH – Lumberg Automation™ – reserves the right to make technical changes or changes to this manual at any time without notice.

1.2 Explanation of symbols

1.2.1 Use of danger information

Danger information is denoted as follows:



DANGER

Means that death, serious physical injury or substantial damage to property will occur if the required safety measures are not taken.



WARNING

Means that death, serious physical injury or substantial damage to property can occur if the required safety measures are not taken.



CAUTION

Means that minor physical injury or damage to property can occur if the required safety measures are not taken.

1.2.2 Use of general information

General information is denoted as follows:



NOTE

Contains important information on the product, on how to manage the product, or on the respective section of the documentation to which your special attention is being drawn.

1.3 Version information

Index	Created	Changed
Version number	Version 0.7	Version 1.0
Date	November 2016	January 2017
Name/department	MJ / R&D	MJ / R&D

Version number

Date

Name/department

Table 1: Overview of manual revisions

1.4 Designations and synonyms

LioN-P 30	LioN-P devices with a width of 30mm
LioN-P 60	LioN-P devices with a width of 60mm
Type A	IO-Link port specification (Class A)
Type B	IO-Link port specification (Class B)
I/O port	X1 – X8
I/O port pin 4 (C/Q)	Channel A of X1 – X8
I/O port pin 2	Channel B of X1 – X8
U_{Aux}	$U_{Auxiliary}$ 1)
IOL or IO-L	IO-Link
IOL-M	IO-Link Master
IOL-D	IO-Link Device
ISDU	Indexed Service Data Unit
UINT	Unsigned Integer, 16 Bit
USINT	Unsigned Short Integer, 8 Bit
Little Endian 2)	Data format of Rockwell Controller, LSB – MSB
Big Endian 2)	Data format of IO-Link communication, MSB - LSB

1) $U_{auxiliary}$ is the auxiliary power supply to the IO-Link type B ports X5 – X8 or the actuator power supply to the digital 2.0 A outputs on ports X5 – X8 (LioN-P 60).

2) If not other mentioned, the data from IO-Link device to EtherNet/IP Scanner, or EtherNet/IP Scanner to IO-Link device will be transferred by the IO-Link master without any byte swapping.

2 Safety instructions

2.1 Intended use

The devices described in this manual are decentralized input/output assemblies on a EtherNet/IP network.

We adhere to all safety standards when developing, producing, testing, and documenting our products. When you adhere to the handling specifications and safety instructions described for the configuration, assembly, and correct operation, there should not normally be any risks for people or equipment.

The modules fulfill the requirements of the EMC guidelines (89/336/EEC, 93/68/EEC and 93/44/EEC) and the low voltage guideline (73/23/EEC).

The modules are designed to be used in the industrial sector. The industrial environment is distinguished by the fact that the consumer is not connected directly to the public low voltage network. Additional measures are required for use in residential areas or in business and commercial sectors.

i NOTE
This equipment may cause radio interference in residential areas. In this case the operator may be requested to carry out appropriate measures.

The proper and safe operation of this product depends on proper transportation, storage, assembly, and installation, and careful operation.

A completely assembled device housing is required for the proper operation of the modules. Only connect devices to the modules that fulfill the requirements of EN 61558-2-4 and EN 61558-2-6.

During the configuration, installation, start-up, maintenance, and testing of the devices, adhere to the safety and accident-prevention guidelines for the specific application.

Only install cables and accessories that fulfill the requirements and regulations for safety, electromagnetic compatibility, and, where applicable, telecommunication end devices, as well as the specification information. Information on which cables and accessories are permitted for the installation can be obtained from Lumberg Automation™ or is contained in this manual.

2.2 Qualified personnel

The configuration, installation, start-up, maintenance, and testing of the devices may only be performed by a qualified electrician who is familiar with the safety standards of the automation technology.

The personnel requirements are based on the requirement profiles described by ZVEI, VDMA, or equivalent organizations.

Only electricians who are familiar with the content of this manual are authorized to install and maintain the devices described. These are persons who

- ▶ based on their technical training, knowledge, and experience, and their knowledge of the pertinent standards, can evaluate the work to be carried out and identify any potential risks or
- ▶ based on working for several years in a related sector, have the same level of knowledge as they would have from the relevant technical training.

Only Belden Deutschland GmbH – Lumberg Automation™ – is permitted to make changes to the hardware or software of the products that go beyond the scope of this manual.



WARNING

Making unqualified changes to the hardware or software, or non-adherence to the warning information contained in this manual, can result in serious personal injury or damage to equipment.

3 System description

3.1 About the LioN-P module series

LioN modules (Lumberg input/output Network) function as the interface in an industrial fieldbus system: They enable a central controller on the management level to communicate with the decentralized sensors and actuators on the field level. The line or ring topologies that they can be used to create not only ensure reliable data communication but also significantly reduce the cables required and thus also the costs for installation and maintenance. They additionally enable easy, quick extension.

The modules of the LioN-P series have a very sturdy metal housing made of die-cast zinc. The completely cast device housing protects the module electronics from environmental effects and allows the device to be used in a wide temperature range. Despite the sturdy construction, the modules have compact dimensions and a low weight. They are especially suitable for use in machines and installations with a moderate I/O concentration over separate assemblies

3.2 Special product features

The modules of the LioN-P series have been substantially reduced in size compared with the well-known LioN-R family; the modules have a very rugged metal housing made of die-cast zinc. Housing variants with widths of 30 mm and 60 mm and different connector types are available. The completely cast device housing protects the module electronics from environmental effects and allows the device to be used in a wide temperature range. Despite the sturdy construction, the modules have compact dimensions and a low weight. They are especially suitable for use in machines and installations with a moderate I/O concentration over separate assemblies.

3.3 EtherNet/IP product features

► Robust design:

The connection options provided by the module series are the widely-used M12 connector with D coding and the M12 hybrid connector for the EtherNet/IP network.

The connectors are also color-coded to prevent the ports from being mixed up.

► Data transmission rates:

Featuring a transmission rate of up to 100MBit/s, the EtherNet/IP modules can handle both fast transmission of I/O data and transmission of larger volumes of data.

► Integrated switch:

The integrated Ethernet switch has two PROFINET ports and thus supports the establishment of a line or ring topology for the EtherNet/IP network. The additionally implemented Media Redundancy Protocol (MRP) enables the design of a highly available network infrastructure.

► EtherNet/IP protocol:

The LioN-P IO-Link master modules support the EtherNet/IP protocol. This allows the transmission of time sensitive process data between network components in real-time communication.

► Redundancy function:

In ring topologies, the firmware of the LioN-P modules supports the redundancy function DLR (Device Level Ring). With this function, if the connection is interrupted, the modules immediately switch to an alternative ring segment and thus ensure interruption-free operation. The DLR class supported is “beacon-based” according to the EtherNet/IP specification.

► Integrated web server:

The network parameters such as IP address, subnet mask and gateway can be adjusted using the rotary switch (last octet of the IP address) or the integrated web server. For automated assignment of the network parameters by the relevant server, the modules support the BOOTP and DHCP protocols.

► Diagnostics data:

The modules support extended diagnostics data that can be append to the I/O data.

► EDS-based configuration and parameterization of the I/O ports:

You have the option of configuring and parameterizing the I/O ports on the master modules via EDS.

3.4 I/O port features

- ▶ The master modules support the IO-Link standard v1.1.
 - Parametrization of the IO-Link devices in EtherNet/IP via Class Code 0x80 and Read/Write ISDU services.
 - Parametrization of the IO-Link devices via Belden IO-Link Device Tool as a standalone PC-Application.

- ▶ 8 x IO-Link master ports:

The modules have 4 type A ports with an additional hard-wired digital input on pin 2 of the I/O port.

- Variants with a width of 30mm:

4 x type B ports with electrically isolated auxiliary power supply on pins 2 and 5 of the I/O port with a total of 4A current.

- Variants with a width of 60mm:

4 x type B ports with electrically isolated auxiliary power supply for up to 2 A per port on pins 2 and 5 with a total of 8A current.

The auxiliary power supply can optionally be configured as a digital output.

- ▶ IO-Link port connections:

The IO-Link port connection option provided by the module series is the 5-pin M12 connector, or the 5-pin M8 connector.

► Parameter storage:

The parameter storage function stores and monitors the parameters of the IO-Link device and IO-Link master. The function thus gives you an easy option for replacing the IO-Link device or IO-Link master.

This is possible as of IO-Link specification V1.1 and only if the IO-Link device and the IO-Link master support the function.

► LED:

You can see the status of a port by the color of the matching LEDs and their flash pattern. For details on the meanings of the LED colors, please see section [“LEDs” on page 113](#).

3.5 Integrated web server

► Network parameter display:

The integrated web server gives you the option of viewing network parameters such as the IP address, subnet mask and gateway.

► Displaying diagnoses:

You can view the diagnoses via the integrated web server.

► User management:

You can use the integrated web server for convenient management of all users.

► IO-Link device parameters:

You can read the IO-Link device parameters via the integrated web server and write new parameters in single write mode to the modules. Single write mode doesn't activate the automated parameter storage mechanism.

► Force Mode:

With the force mode output and input values can be set for implementation reasons.

3.6 Other features

► Interface protection:

The modules have reverse polarity, short-circuit and overload protection for all interfaces.

► Failsafe:

The modules support a failsafe function. This allows you to define the behavior of every single channel configured as an output in the case of an interruption or a loss of EtherNet/IP communication.

► Color-coded connectors:

Color-coded connectors help you avoid confusion in your cabling.

► IP protection classes IP65/IP67/IP69k:

The IP protection classes describe environmental influences that the modules can be exposed to without risk and without suffering damage, or causing a risk for the user.

Depending on the module, IP protection classes IP65, IP67 or IP69k are offered.

3.7 Product overview

The following IO-Link masters are available for the LioN-P system:

Article number	Product designation	Description	Power & Ethernet ports	I/O ports
934 879 009	0980 ESL 398-121	LioN-P M12-60, IO-Link EtherNet/IP / PROFINET	PWR - M12 L-coded ETH - M12 D-coded	8 x M12 (Up to 4DO 2A)
934 879 004	0980 ESL 399-121	LioN-P M12-60, IO-Link EtherNet/IP / PROFINET	PWR - M12 L-coded ETH - M12 D-coded	8 x M12 (Up to 8DO 0,5A and up to 4DO 2A)

Table 2: Overview of module variants in the LioN-P series

Article number	Product designation	Description	Power & Ethernet ports	I/O ports
934 964 004	0980 ESL 199-121	LioN-P M12-30, IO-Link EtherNet/IP / PROFINET	PWR - M12 L-coded ETH - M12 D-coded	8 x M12
934 964 002	0980 ESL 199-332	LioN-P M8-30, IO-Link EtherNet/IP / PROFINET	PWR - M12 Hybrid ETH - M12 Hybrid	8 x M8
934 964 001	0980 ESL 199-331	LioN-P M12-30, IO-Link EtherNet/IP / PROFINET	PWR - M12 Hybrid ETH - M12 Hybrid	8 x M12
934 964 003	0980 ESL 199-122	LioN-P M8-30, IO-Link EtherNet/IP / PROFINET	PWR - M12 L-coded ETH - M12 D-coded	8 x M8

Table 2: Overview of module variants in the LioN-P series

As all variants can be used for EtherNet/IP and PROFINET networks, refer to the manual "**Manual_LioN_P_Multiprotocol_EN**" for setting the protocol.

4 Assembly and wiring

4.1 General information

Mount the module with 2 screws (M4x25 / 30) for LioN-P on a level surface. The torque required here is 1 Nm. Use washers for all fastening methods as per DIN 125. For the mounting holes, use the distance from the dimension schematics in chapter 4.2.

i Note

The modules have a ground connection with an M4 thread for the conduction of interference currents and the EMC immunity. This is labeled with the symbol for the ground and the designation "XE"

i Note

Use a low-impedance connection to connect the module to the reference ground. When using a grounded mounting surface, you can make the connection directly via the fixing screws.

i Note

If the mounting surface is ground-free, use a ground strap or a suitable PE line. Use an M4 screw to connect the ground strap or the PE line to the ground point and if possible put a washer and a toothed washer below the fixing screw.

i Note

For UL application:

Be sure to use a UL-certified cable with a suitable evaluation to connect the devices (CYJV or PVVA). To program the control, please refer to the OEM information, and only use suitable accessories.

i Note

For UL application:

Only approved for interior use. Please note the maximum elevation of 2000 meters. Approved up to a maximum soiling level of 2.

**WARNING**

Terminals, housings field-wired terminal boxes or components can exceed temperatures of 60 °C.

**WARNING**

For UL application:

Use temperature-resistant cables with the following properties:

For the module 0980 ESL 1x9-xxx heat-resistant up to at least 85 °C.

For the modules 0980 ESL 3x8-121 and 0980 ESL 3x9-121 heat-resistant up to at least 96 °C.

4.2 Outer dimensions

4.2.1 Module 0980 ESL 398-121 & ESL 399-121


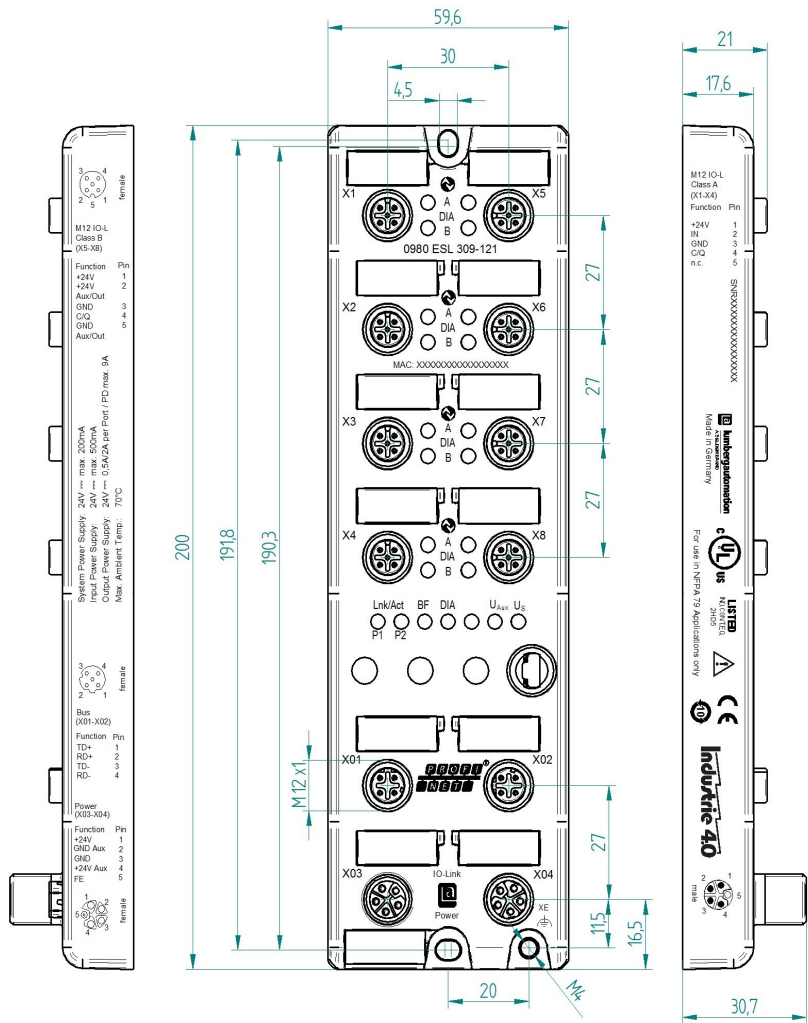


Figure 1: Dimension 0980 ESL 3xx-121

4.2.2 Module 0980 ESL 199-121

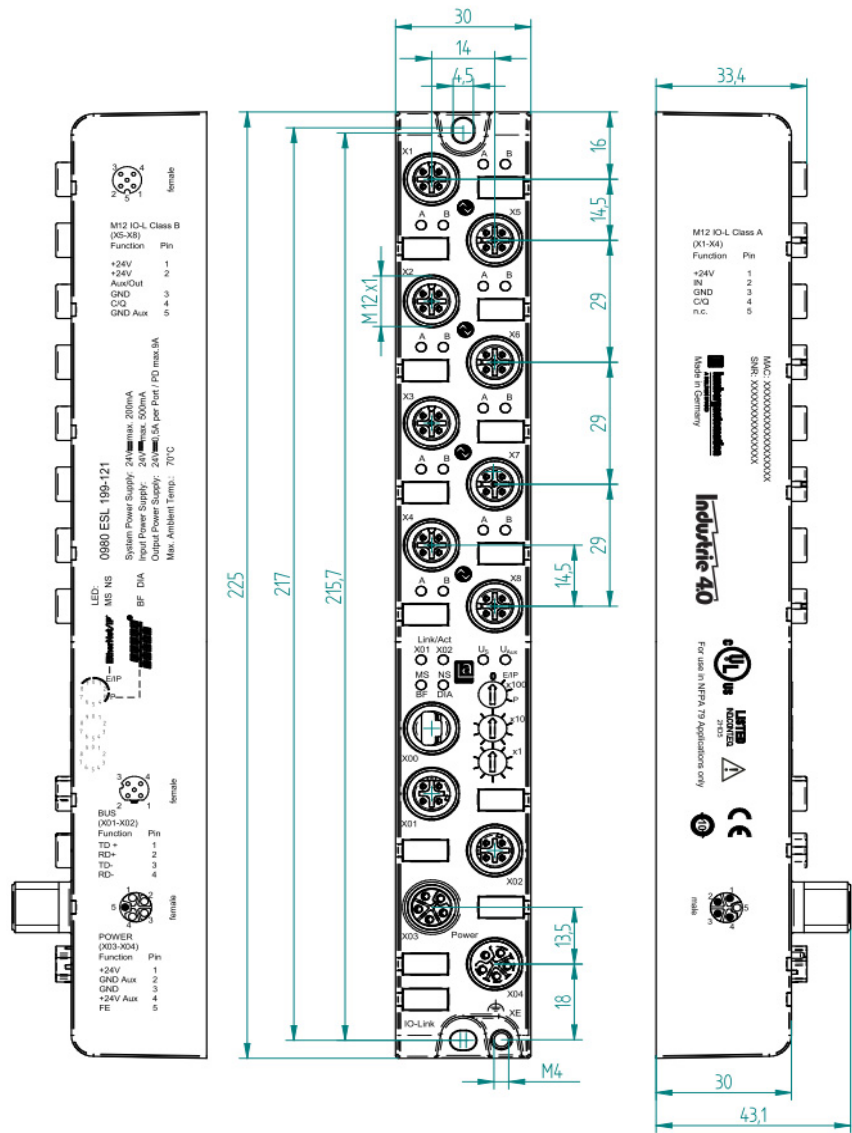

4.2.3 Module 0980 ESL 199-332

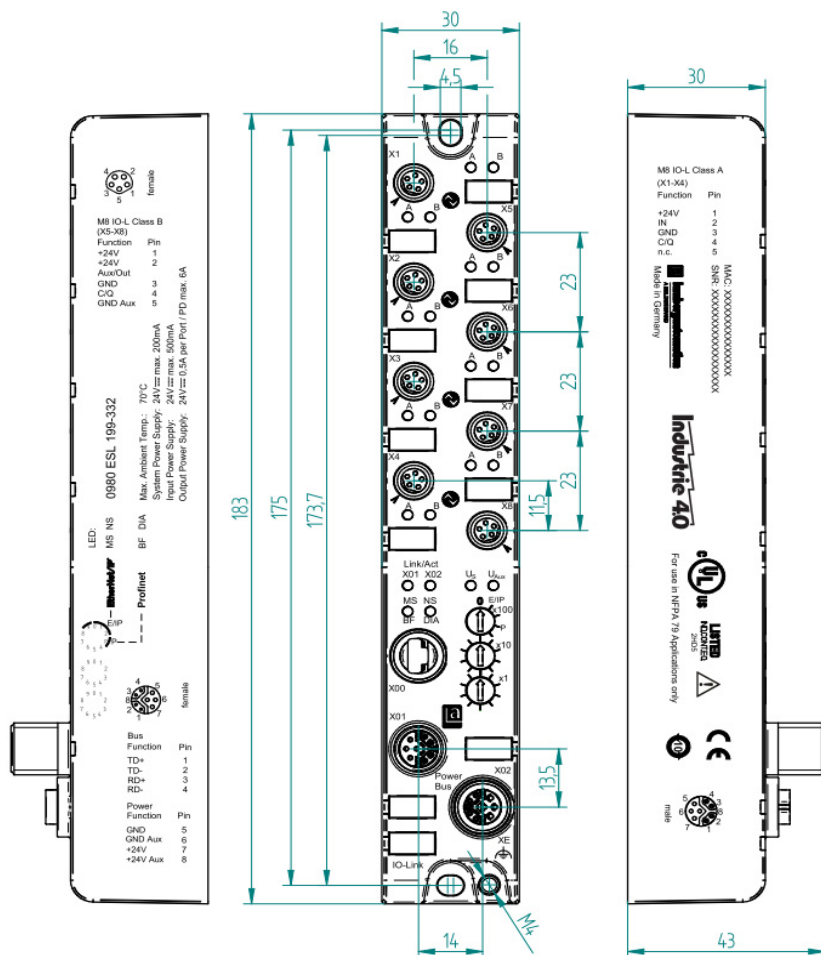


Figure 3: Dimension 0980 ESL 199-332

4.2.4 Module 0980 ESL 199-122

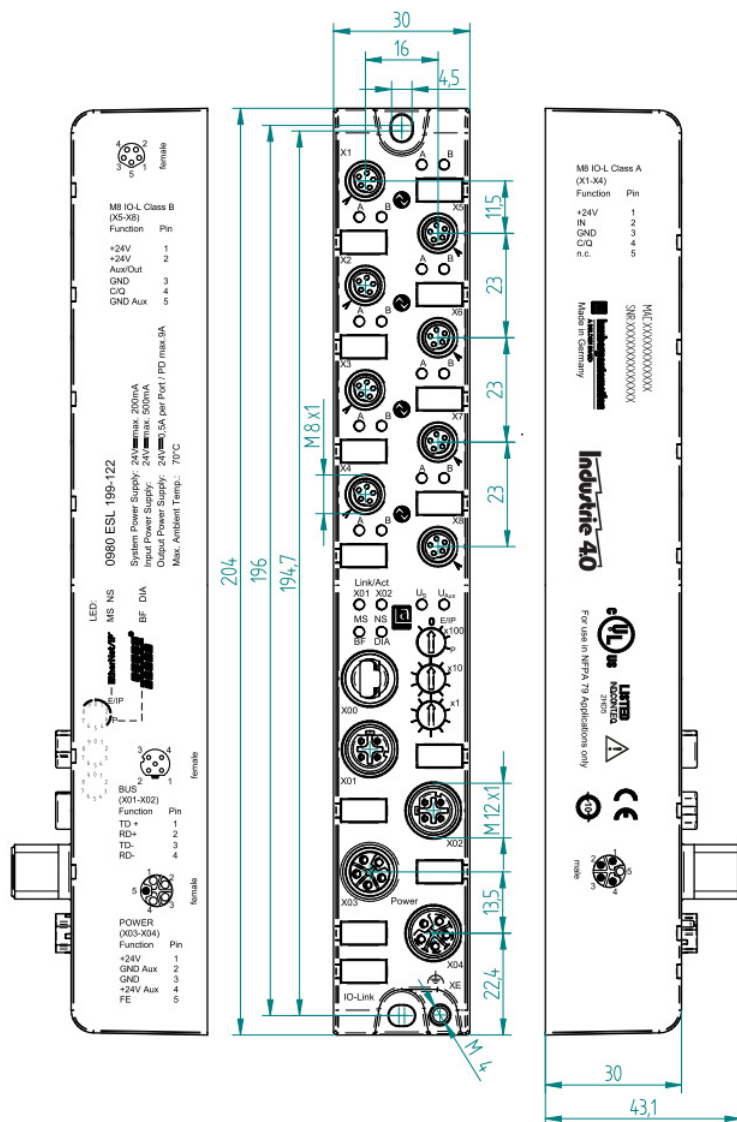


Figure 4: Dimension 0980 ESL199-122

4.2.5 Module 0980 ESL 199-331

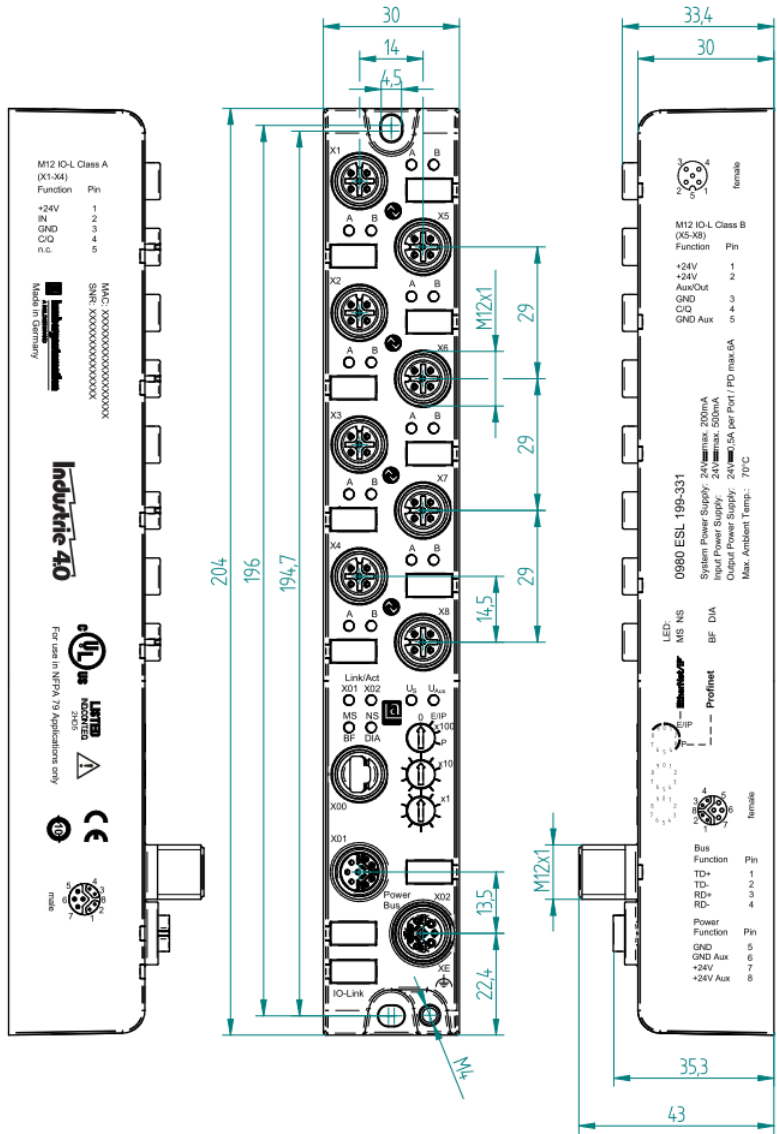


Figure 5: Dimension 0980 ESL 199-331

4.3 Port assignments

All the contact arrangements shown in this chapter show the frontal view of the connection area for the connectors.

4.3.1 Ethernet ports

- Design: M12 socket, 4-pin, D-coded
- Color coding: green




Figure 6: Schematic drawing, ports X01, X02

Port	Pin	Signal	Function
Ethernet X01, X02	1	TD+	Transmit data +
	2	RD+	Receive data +
	3	TD-	Transmit data -
	4	RD-	Receive data -

Table 3: Assignment of ports X01, X02



CAUTION

Risk of destruction! Never connect the power supply to the data cables.

4.3.2 Power supply with M12 power L-coded

► Color coding: gray




Figure 7: Schematic diagram of the M12 L-coding (connector), port X03 (IN)




Figure 8: Schematic diagram of the M12 L-coding (socket), port X04 (OUT)

Power supply	Pin	Signal	Function
	1	U_s (+24V)	Sensor/system power supply
	2	$GND_{-U_{Aux}}$	Ground/reference potential U_{aux}
	3	GND_{-U_s}	Ground/reference potential U_s
	4	U_{Aux} (+24V)	Auxiliary supply (electrically isolated)
	5	FE (PE)	Functional ground

Table 4: Power supply with M12--Power

i NOTE

Only use power supply units for the system/sensor and actuator supply that correspond to PELV (Protective Extra Low Voltage) or SELV (Safety Extra Low Voltage). Power supplies according to EN 61558-2-6 (transformers) or EN 60950-1 (switching power supply units) fulfill these requirements.

4.3.3 EtherNet/IP and power supply with M12 Hybrid

► Color coding: gray




Figure 9: Schematic diagram of the M12 Hybrid (connector)




Figure 10: Schematic diagram of the M12 Hybrid (socket)

Ether + Power Supply	Pin	Signal	Function
	1	TD +	Transmit data plus
	2	TD -	Transmit data minus
	3	RD +	Receive data plus
	4	RD -	Receive data minus
	5	GND_ U_S	Ground/reference potential U_S
	6	GND_ U_{Aux}	Ground/reference potential U_{aux}
	7	$U_S(+24V)$	Sensor/system power supply
	8	$U_{Aux} (+24V)$	Auxiliary supply (electrically isolated)

Table 5: Ethernet and power supply with M12 Hybrid

i NOTE

Only use power supply units for the system/sensor and actuator supply that correspond to PELV (Protective Extra Low Voltage) or SELV (Safety Extra Low Voltage). Power supplies according to EN 61558-2-6 (transformers) or EN 60950-1 (switching power supply units) fulfill these requirements.

4.3.4 I/O ports as M8 or M12 sockets

■ IO-Link type A

► Color coding: black




Figure 11: Schematic drawing I/O port as M8 socket IO-Link type A




Figure 12: Schematic drawing I/O port as M12 socket IO-Link type A

Port	Pin	Signal	Function
IO-Link Type A X1 - X4	1	L +	IO-Link sensor power supply + 24V
	2	IN-x	Ch. B: Digital input (Type 1)
	3	L -	IO-Link sensor supply GND_U _S
	4	C/Q	Ch. A: IO-Link data communication
	5	NC	not connected

Table 6: I/O ports as M8 or M12 socket IO-Link type A

IO-Link type B
▶ Color coding: black




Figure 13: Schematic drawing I/O port as M8 socket IO-Link type B




Figure 14: Schematic drawing I/O port as M12 socket IO-Link type B

Port	Pin	Signal	Function
IO-Link Type B X5 - X8	1	L +	IO-Link sensor power supply +24V
	2	U _{Aux} (+24V)	Auxiliary power supply (electrically isolated with respect to the sensor/system power supply)
	3	L -	IO-Link sensor supply GND_U _S
	4	C/Q	Ch. A: IO-Link data communication
	5	GND_U _{Aux}	Ground/reference potential U _{Aux}

Table 7: I/O ports as M8 or M12 socket IO-Link type B

5 Starting operation

5.1 Downloading and installing the EDS file

An EDS file is required for the configuration of a module in the controller. Each of the variants requires its own EDS file. You have the option of downloading the EDS file from our website or asking our support team to send it to you. The address of the website is:

http://www.beldensolutions.com/en/Service/download_center/.

The EDS files are grouped together in an archive file with the name
`LioN-P ETHERNET-IP IO-Link EDS V3.11.1`.

Download this file and unpack it.

The archive contains the following EDS files:

- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL199-121-yyyymmdd.eds`
- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL199-122-yyyymmdd.eds`
- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL199-331-yyyymmdd.eds`
- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL199-332-yyyymmdd.eds`
- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL398-121-yyyymmdd.eds`
- ▶ `EDS-V3.11.1-LumbergAutomation-0980ESL399-121-yyyymmdd.eds`

yyyymmdd stands for the date on which the file was issued.

Install the EDS file for the module variant in use with the aid of the hardware or network configuration tool of your controller manufacturer. After installation the modules are available in the hardware catalogs as a "Communications Adapter" device.

5.2 Reading the MAC addresses

Every module has three unique MAC addresses assigned by the manufacturer that cannot be changed by the user. The first assigned MAC address is printed on the module.

5.3 Setting the network parameters

You can use the 3 rotary switches on the front of the modules to set the operation mode for receiving the network parameters such as IP address, subnet mask, and gateway address.

After the power supply is restored, the modules read the switch settings. The selected operation mode overwrites the stored settings.

The devices support the DHCP and BOOTP protocols for receiving the required network parameters such as IP address and subnet mask.

The factory settings of the static network parameters are:

- ▶ IP address: 192.168.001.001
- ▶ Subnet mask: 255.255.255.000
- ▶ Gateway address: 000.000.000.000

Using the rotary encoding switches, the following settings are possible for EtherNet/IP LioN-P modules:

Rotary switch setting	Function
000 (state on delivery)	In the state on delivery, the DHCP and BOOTP functions are activated. The network parameters are initially requested via DHCP requests. If this is not successful, BOOTP requests are used. The network parameters are not saved, but the integrated web server can be used to save them.
000 (network parameters already saved)	The network parameters last saved are used (IP address, subnet mask, gateway address, DHCP on/off, BOOTP on/off).
001 ... 254	The last 3 digits of the saved or preset IP address are overwritten by the setting of the rotary switch.
255 ... 298	The network parameters are requested via DHCP and BOOTP but are not saved.
299	The factory setting of the IP address (192.168.001.001) is used.
979	The device performs a reset to the factory settings. The network parameters are also reset to the default values. Communication is not possible in this operation mode.


Table 8: Setting options of the rotary encoding switches for EtherNet/IP modules

For additional multiprotocol information refer the manual
Manual_LioN_P_Multiprotocol_EN.pdf


5.4 Configuration of the device with RsLogix 5000

The configuration and start-up of the modules described on the following pages refers to the RSLogix 5000 software from Rockwell Automation. If you are using a control system from another provider, please consider the related documentation.


- ☐ Install the EDS files of the modules in "RSLogix 5000" with the EDS Hardware Installation Tool in the "Tools" menu.
- ☐ Select the correct controller.
- ☐ Go to the "I/O-Configuration" section in the "Controller Organizer" and right-click "Ethernet".
- ☐ Select the "New Module" menu item. The following selection window opens.

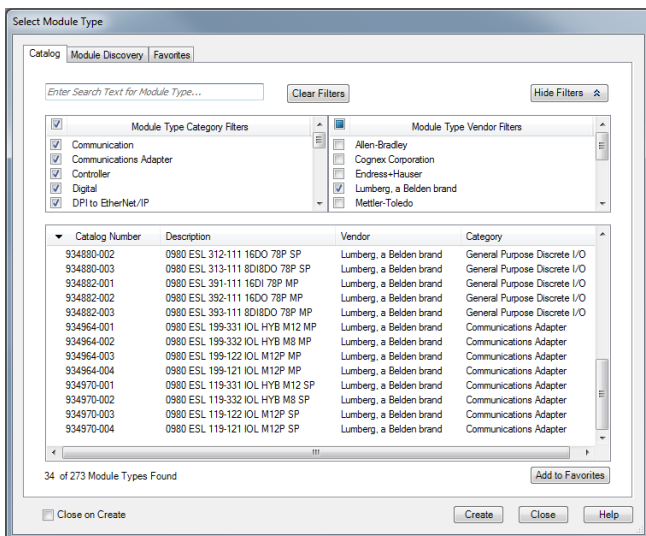


- ☐ Use the Module Type Vendor Filter on the right side to display all installed modules of "Lumberg, a Belden brand".
- ☐ Select the module to be added and click the "Create" button.

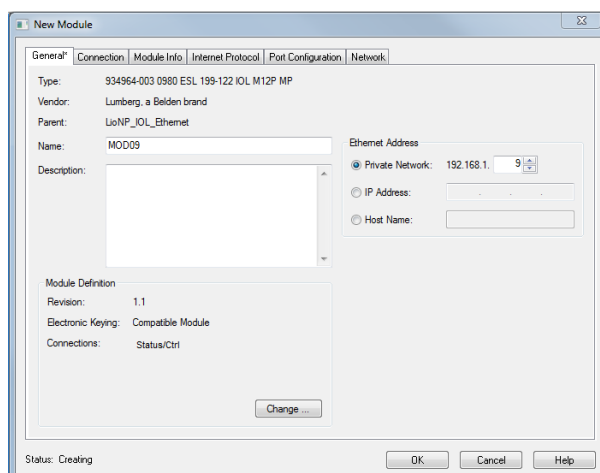


- ☐ Enter a name for the module and the correct IP address. In this example, the name is "MOD09" and the IP address is 192.168.1.9.
- ☐ Click the "Change" button and change the settings for the module revision, electronic keying, and connection type.

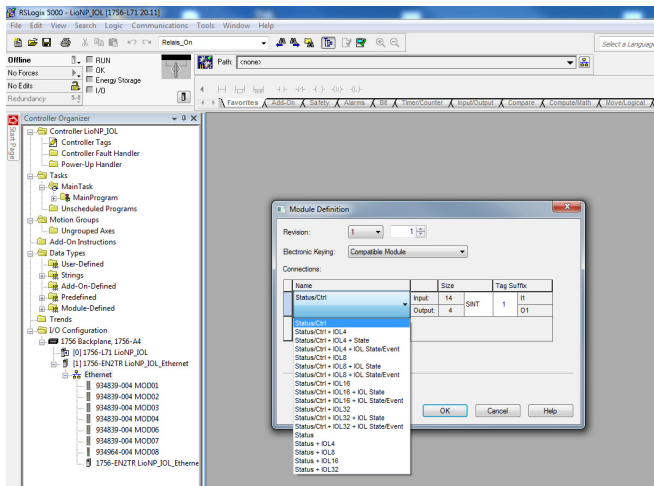

- ☐ Select the connection type. This specifies which process and diagnostic data the module provides. The connections and its assemblies are described in chapter [“Connections” on page 59](#).
- ☐ In the "Connections" folder of the "Module Properties", you will see the selected connection type. This folder also lets you define the "Requested-Packet-Interval (RPI)" and the input type ("Input Type"). A value of 1 ms is the minimum for parameter RPI.

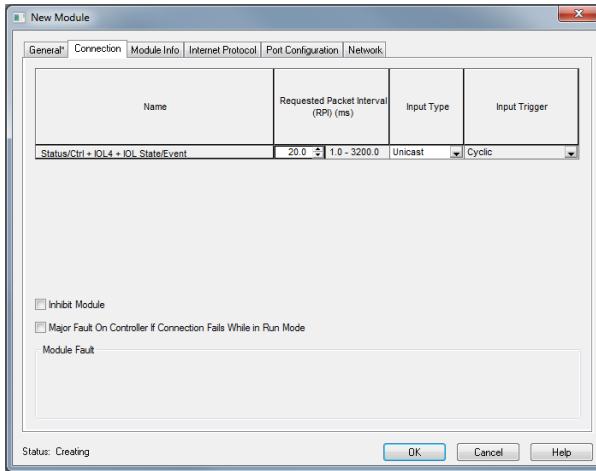

- Change to the "Controller-Tags" section in "Controller Organizer". The controller tags for the configuration parameters contain the name of the module, followed by a ":C". The configuration parameters can be set in the Value column and are described in the following chapter.

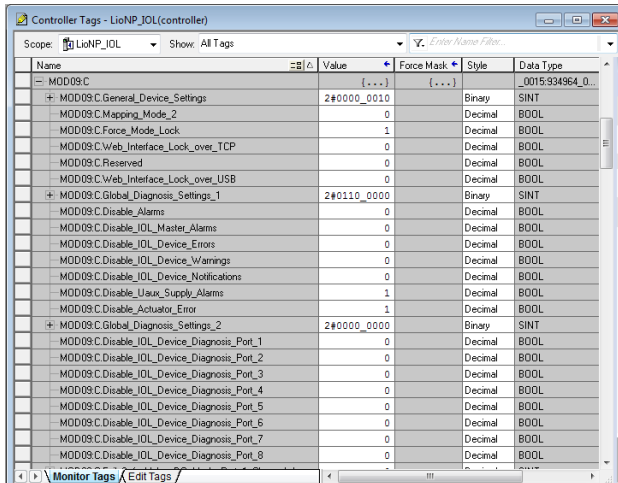

6 Parameter of the IO-Link Master

The following chapter describes the parameter of the IO-Link master. The parameter must be transferred to the IO-Link master after powering-up. The parameter contains among other things also the IO-Link port mode. The IO-Link port data length is chosen out of the different available connections.

The default settings in the following tables are highlighted.

6.1 General Device Settings

Para. No.	Function	Bit	Description
1	General device settings	0	0 = Mapping Mode 1 1 = Mapping Mode 2
		1	0 = Force mode via web interface enabled 1 = Force mode via web interface disabled
		2	0 = Web interface over TCP enabled 1 = Web interface over TCP disabled
		3	0 = Automatic restart after failure (Ports 5 - 8) enabled 1 = Automatic restart after failure (Ports 5 - 8) disabled
		4	0 reserved
		5	0 reserved
		6	0 reserved
		7	0 reserved

Table 9: General device settings

■ Mapping Mode, Bit 0

The "Digital-I/O Bit Mapping Mode" parameter can be used to define the mappings of the input/output bits that are transmitted in the cyclical status and control data of the Module.

► MM1: Default Mapping

In Mapping Mode 1 (MM1), the first channel bit (C/Q, Ch. A / Pin 4) and the second channel bit (Ch. B / Pin2) are transmitted alternately in ascending order for all ports.

► MM2: E2C Compatible Mapping

In Mapping Mode 2 (MM2), the first channel bits (C/Q, Ch. A / Pin 4) and the second channel bits (Ch. B / Pin2) are transmitted consecutively in ascending order for all ports.

The different formats are also shown in section ["Connections" on page 59](#).

6.2 Global diagnosis parameter

Para. No.	Function	Bit	Description
2	Global diagnosis parameter	0	0 = All diagnosis enabled 1 = All diagnosis disabled
		1	0 = IO-Link Master diagnosis enabled 1 = IO-Link Master diagnosis disabled
		2	0 = IO-Link Device error diagnosis enabled 1 = IO-Link Device error diagnosis disabled
		3	0 = IO-Link Device warning diagnosis enabled 1 = IO-Link Device warning diagnosis disabled
		4	0 = IO-Link Device notification diagnosis enabled 1 = IO-Link Device notification diagnosis disabled
		5	0 = U _{Aux} supply diagnosis enabled (default 0980 ESL 3x8-121) 1 = U_{Aux} supply diagnosis disabled
		6	0 reserved, do not use
		7	0 reserved, do not use

Table 10: Global diagnosis parameter

Para. No.	Function	Bit	Description
3	Global diagnosis parameter	0	0 = IO-Link port 1 device diagnosis enabled 1 = IO-Link port 1 device diagnosis disabled
		1	0 = IO-Link port 2 device diagnosis enabled 1 = IO-Link port 2 device diagnosis disabled
		2	0 = IO-Link port 3 device diagnosis enabled 1 = IO-Link Port 3 device diagnosis disabled
		3	0 = IO-Link port 4 device diagnosis enabled 1 = IO-Link port 4 device diagnosis disabled
		4	0 = IO-Link port 5 device diagnosis enabled 1 = IO-Link port 5 device diagnosis disabled
		5	0 = IO-Link port 6 device diagnosis enabled 1 = IO-Link port 6 device diagnosis disabled
		6	0 = IO-Link port 7 device diagnosis enabled 1 = IO-Link port 7 device diagnosis disabled
		7	0 = IO-Link port 8 device diagnosis enabled 1 = IO-Link port 8 device diagnosis disabled

Table 10: Global diagnosis parameter

6.3 Failsafe parameter for digital outputs

The IO-Link master supports a failsafe function for the channels used as digital outputs. During the devices configuration the status of the outputs can be defined after an interruption or loss of communication on the EtherNet/IP network.

The following options can be selected:

- ▶ **Set Low:** the output channel is disabled and/or the output bit set to 0.
- ▶ **Set High:** the output channel is enabled and/or the output bit set to 1.
- ▶ **Hold Last:** the last output state is kept.

Para. No.	Function	Bit	Description
4	Failsafe Value DO Mode Port 1 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change

Table 11: Failsafe parameter for digital outputs

Para. No.	Function	Bit	Description
5	Failsafe Value DO Mode Port 2 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
6	Failsafe Value DO Mode Port 3 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
7	Failsafe Value DO Mode Port 4 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
8	Failsafe Value DO Mode Port 5 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
9	Failsafe Value DO Mode Port 6 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
10	Failsafe Value DO Mode Port 7 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
11	Failsafe Value DO Mode Port 8 Channel A	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
40	Failsafe Value DO Mode Port 1 Channel B	0 - 1	0 = DO not available, do not change
		2 - 7	0 = reserved, do not change
41	Failsafe Value DO Mode Port 2 Channel B	0 - 1	0 = DO not available, do not change
		2 - 7	0 = reserved, do not change
42	Failsafe Value DO Mode Port 3 Channel B	0 - 1	0 = DO not available, do not change
		2 - 7	0 = reserved, do not change
43	Failsafe Value DO Mode Port 4 Channel B	0 - 1	0 = DO not available, do not change
		2 - 7	0 = reserved, do not change

Table 11: Failsafe parameter for digital outputs

Para. No.	Function	Bit	Description
12	Failsafe Value DO Mode Port 5 Channel B (LioN-P 60 only)	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
13	Failsafe Value DO Mode Port 6 Channel B (LioN-P 60 only)	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
14	Failsafe Value DO Mode Port 7 Channel B (LioN-P 60 only)	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
15	Failsafe Value DO Mode Port 8 Channel B (LioN-P 60 only)	0 - 1	0 = Set Low 1 = Set High 2 = Hold Last
		2 - 7	0 = reserved, do not change
16	Reserved 1	0 - 8	0 = reserved, do not change

Table 11: Failsafe parameter for digital outputs

6.4 Surveillance timeout parameter, LioN-P 60

For LioN-P 60 devices, the separate power supply U_{Aux} , which is available on type B IO-Link channels (Ch.B / Pin2), ports 5-8 can also be configured as an additional digital output (See table 14 on page 48.). This gives you the option of switching the power supply like a digital output.

The firmware of the modules allows you to configure a delay time before output current monitoring is enabled for this special use case.

The delay time is referred to as the "Surveillance-Timeout" and can be configured for each output channel. The delay time begins after the state of the output channel changes, i.e., when it is activated (after a rising edge) or deactivated (after a falling edge). After this time has elapsed the output is monitored and error states are reported by diagnostics.

The "Surveillance-Timeout" parameter can be set from 0 to 255 ms. The default value of this parameter is 80 ms. When an output channel is in static state, i.e., when the channel is permanently switched on or off the typical value is 5 ms.

Para. No.	Function	Bit	Description
20	Surveillance Timeout Port 1 Channel B	0 - 16	0 = DO not available, reserved
21	Surveillance Timeout Port 2 Channel B	0 - 16	0 = DO not available, reserved
22	Surveillance Timeout Port 3 Channel B	0 - 16	0 = DO not available, reserved
23	Surveillance Timeout Port 4 Channel B	0 - 16	0 = DO not available, reserved
24	Surveillance Timeout Port 5 Channel B	0 - 16	0 ms = Min. Value 80 ms = Default Value 255 ms = Max. Value
25	Surveillance Timeout Port 6 Channel B	0 - 16	0 ms = Min. Value 80 ms = Default Value 255 ms = Max. Value
26	Surveillance Timeout Port 7 Channel B	0 - 16	0 ms = Min. Value 80 ms = Default Value 255 ms = Max. Value
27	Surveillance Timeout Port 8 Channel B	0 - 16	0 ms = Min. Value 80 ms = Default Value 255 ms = Max. Value

Table 12: Surveillance Timeout

6.5 Digital input logic

The standard input logic (normally open) can be inverted to normally closed. In case of normally closed setting a high level will be transferred to the EtherNet/IP Scanner for a physical low level at the digital input port. The port LED logic remains unchanged from the input logic settings. The LED shows the physical input status of the port.

Para. No.	Function	Bit	Description
28	Digital Input Logic Channel A	0	0 = Normally Open Port 1A 1 = Normally Closed Port 1A
		1	0 = Normally Open Port 2A 1 = Normally Closed Port 2A
		2	0 = Normally Open Port 3A 1 = Normally Closed Port 3A
		3	0 = Normally Open Port 4A 1 = Normally Closed Port 4A
		4	0 = Normally Open Port 5A 1 = Normally Closed Port 5A
		5	0 = Normally Open Port 6A 1 = Normally Closed Port 6A
		6	0 = Normally Open Port 7A 1 = Normally Closed Port 7A
		7	0 = Normally Open Port 8A 1 = Normally Closed Port 8A
29	Digital Input Logic Channel B	0	0 = Normally Open Port 1B 1 = Normally Closed Port 1B
		1	0 = Normally Open Port 2B 1 = Normally Closed Port 2B
		2	0 = Normally Open Port 3B 1 = Normally Closed Port 3B
		3	0 = Normally Open Port 4B 1 = Normally Closed Port 4B
		4	0 = Input not available, do not change
		5	0 = Input not available, do not change
		6	0 = Input not available, do not change
		7	0 = Input not available, do not change

Table 13: Digital input logic

6.6 Digital I/O mode channel B, LioN-P 60

With this parameters the function for the ports 5 - 8 (IO-Link type B) of channel B can be chosen.

Para. No.	Function	Bit	Description
30	Digital I/O Mode Port 1, Channel B	0 - 7	0 = DI, function not changeable
30	Digital I/O Mode Port 2, Channel B	0 - 7	0 = DI, function not changeable
32	Digital I/O Mode Port 3, Channel B	0 - 7	0 = DI, function not changeable
33	Digital I/O Mode Port 4, Channel B	0 - 7	0 = DI, function not changeable
34	Digital I/O Mode Port 5, Channel B	0 - 1	0 = Reserved 1 = Auxiliary Power 2 = Digital Output 3 = Inactive
		2 - 7	0 = reserved, do not change
35	Digital I/O Mode Port 6, Channel B	0 - 1	0 = Reserved 1 = Auxiliary Power 2 = Digital Output 3 = Inactive
		2 - 7	0 = reserved, do not change
36	Digital I/O Mode Port 7, Channel B	0 - 1	0 = Reserved 1 = Auxiliary Power 2 = Digital Output 3 = Inactive
		2 - 7	0 = reserved, do not change
37	Digital I/O Mode Port 8, Channel B	0 - 1	0 = Reserved 1 = Auxiliary Power 2 = Digital Output 3 = Inactive
		2 - 7	0 = reserved, do not change

Table 14: Digital I/O mode channel B

► **Auxiliary Power:**

In this mode pin 2 and pin 5 of the type B IO-Link ports (ports 5 - 8) act as an auxiliary voltage output. The auxiliary voltage is fed from the U_{Aux} supply input. The auxiliary voltage output cannot be controlled.

► **Digital Output (DO):**

In this mode ch. B/Pin 2 of the type B IO-Link ports (ports 5 - 8) can be used as a digital output. The control bits are transferred by the digital output control bytes to the device. A "Surveillance-Timeout" can be parameterized for the outputs (See table 12 on page 46.).

6.7 IO-Link port mode parameter (channel A)

With this parameter the function of the channel A IO-Link ports can be chosen. The following modes are available:

► **Inactive:**

This mode should be selected if the channel is not used. In this case the L+ power supply (pin 1) of the port is disabled.

► **Digital Input:**

In this mode the channel operates as a digital input. The IO-Link master does not try to independently establish communication to the connected IO-Link device.

However, the cyclical output bits in the **ComCntrl** byte of the IO-Link master can be used to set the appropriate channels in COM mode and thus enable the IO-Link device for parametrization.

i NOTE
Please note that the status of the digital input signal is not updated during optional COM operations.

► **Digital Output:**

In this mode the channel operates as a digital output. It is impossible at any time to communicate with the connected device.

The "Digital Output" option for the IO-Link C/Q channel (ch. A/pin4) is not available for the 0980 ESL 3x8-121 device.

► **SIO mode (DI):**

This mode is used to parameterize the IO-Link devices. It relies on the fallback mechanism from COM mode to SIO mode without using the ComCntrl bits in the IO-Link master's ComCntrl byte. In this mode the IO-Link device is parameterized during the module's startup time and changes back to digital input mode via the fallback mechanism.

► **IO-Link:**

In this mode (COM mode) the process data from or to the device is exchanged over a communication link. The IO-Link master starts communicating with the connected IO-Link device automatically taking into account the baud rate. Additionally, this mode offers the option of parameterizing the IO-Link device.

Connections with data lengths of 4, 8, 16 and 32 input and output bytes are available. If no suitable connection is available for the device, the next larger data length has to be selected.

Para. No.	Function	Bit	Description
53	Digital I/O Mode Port 1, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change
54	Digital I/O Mode Port 2, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change

Table 15: IO-Link port mode

Para. No.	Function	Bit	Description
55	Digital I/O Mode Port 3, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change
56	Digital I/O Mode Port 4, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change
57	Digital I/O Mode Port 5, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change
58	Digital I/O Mode Port 6, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change
59	Digital I/O Mode Port 7, Channel B	0 - 2	0 = Inactive 1 = DI 2 = DO 3 = SIO 4 = IO-Link
		3 - 7	0 = reserved, do not change

Table 15: IO-Link port mode

6.8 IO-Link port extended parameter

For every IO-Link port (Channel A) the "Parameter Storage" and "Validation Mode" of the IO-Link master can be set. For every IO-Link port there is a parameter block of 22 Bytes available.

Para. No.	Function	Bit	Description
62 ... 70	IO-L Port 1 Parameter		See the following table
72 ... 80	IO-L Port 2 Parameter		See the following table
82 ... 90	IO-L Port 3 Parameter		See the following table
92 ... 100	IO-L Port 4 Parameter		See the following table
102 ... 110	IO-L Port 5 Parameter		See the following table
112 ... 120	IO-L Port 6 Parameter		See the following table
122 ... 130	IO-L Port 7 Parameter		See the following table
132 ... 140	IO-L Port 8 Parameter		See the following table

Table 16: IO-Link port extended parameter overview

Para. No.	Function	Bit	Description
62	Parameter Storage Port 1	0 - 3	0 = Disabled 1 = Download (master to device) 2 = Upload (device to master) 3 = Download & Upload 4 = Disabled & Cleared
		4 - 7	0 = reserved, do not change
63	Device Validation Mode Port 1	0 - 3	0 = No Validation 1 = Compatible with entered values 2 = Identical with entered values
		4 - 7	0 = reserved, do not change
64	Vendor ID (MSB) Port 1	0 - 7	0 ... 255
65	Vendor ID (LSB) Port 1	0 - 7	0 ... 255
66	Device ID (MSB) Port 1	0 - 7	0 ... 255

Table 17: IO-Link port extended parameter

Para. No.	Function	Bit	Description
67	Device ID Port 1	0 - 7	0 ... 255
68	Device ID (LSB) Port 1	0 - 7	0 ... 255
69	Serial Number of IO-Link Device Port 1 (16 Bytes)	0 - 7	Serial Number Byte 1 (MSB)
		...	...
		0 - 7	Serial Number Byte 16 (LSB)
-	Reserved	0 - 7	0 = reserved, do not change
70	Fail Safe Behavior IO-Link Port 1	0 - 3	0 = Set Low 1 = Set High 2 = Hold Last Value 3 = Replacement Value (transferred via Class Code 0x81) 4 = Command
		4 - 7	0 = reserved, do not change

Table 17: IO-Link port extended parameter

■ IO-L Parameter storage

The parameter server of the IO-Link master can be parameterized in the "Parameter storage" tab. The "Parameter storage" function manages the IO-Link device parameters to enable a simple device or master replacement.

The following options can be set:

► Disabled:

Disabled mode is the default setting in as-delivered condition. The data maintenance function is disabled. If parameter data of a device were stored previously, these data remain stored without any changes.

► Download only (master to device):

Enables the parameter data download function to the IO-Link device on the master.

Parameter data can only be uploaded to an IO-Link device if they exist on the parameter server and are usable for the device. When an IO-Link device is connected, the master compares the stored parameter data with the device data. If the function is not locked on the device ("Parameter storage" locked), the master downloads the stored data to the device in case of differences.

IO-Link device data can be loaded using the "Upload only" mode. If the master does not have a device parameter set stored, the mode must be compared with "Disabled".

Replacement of the IO-Link device is possible in this mode.

► Upload only (device to master):

Enables the parameter data upload function to the IO-Link master from the device.

An upload is performed when an IO-Link device is connected and the master does not have any valid data. This is the case if "Disabled and Cleared" mode was configured previously and/or in case of "Disabled" in as-delivered condition.

If parameter data are changed on the device during runtime, the device data stored on the master can be overwritten using the ParamDownloadStore (Index 0x0002, Subindex 0x00, Value 0x05) command. This command sets the DS_UPLOAD_REQ flag on the device, and thus executes an upload.

The IO-Link master can be replaced in this mode.

► Download and Upload:

Enables the IO-Link parameter data download and upload function.

An upload is performed when an IO-Link device is connected and the master does not have any valid data. This is the case if "Disabled and Cleared" mode was configured previously and/or in case of "Disabled" in as-delivered condition. The parameter data read are permanently stored on the master.

If parameter data are changed on the device during runtime, the device data stored on the master can be overwritten using the ParamDownloadStore (Index 0x0002, Subindex 0x00, Value 0x05) command. This command sets the DS_UPLOAD_REQ flag on the device, and thus executes an upload.

For each new connection to an IO-Link device, the master compares the stored parameter data with the device data. If the function is not locked on the device ("Parameter storage" locked), the master downloads the stored data to the device in case of differences.

The IO-Link device can be replaced in this mode.

Action	IO-Link Master State	IO-Link Device State
Upload	Invalid Data (Cleared before)	Upload Flag active (Valid Data)
Upload	Invalid Data (Cleared before)	Upload Flag not active & Valid Data
Upload	Valid Data	Upload Flag active & Valid Data
Download	Valid Data	Upload Flag not active (data equal)

Table 18: Download and upload states

► Disabled and Cleared

The data retention function is disabled; and stored data are deleted.

NOTE

The IO-Link device sets the "Upload Flag" self-dependent when parameters were written in block mode.

■ IO-L Device Validation

The IO-L Device Validation (IO-Link device Identification) lets you check the connected devices for the values set in the control program in order to, e.g., identify correctly connected devices and not start operations with them.

► Validation Mode

– No Validation

This option is the default setting. In this case neither the VendorID, DeviceID, nor the serial number are synchronized after powering on between the IO-Link device and the entered IO-Link master data before communication starts.

– Compatible with entered values

With this option, the VendorID and DeviceID are synchronized after powering on between the IO-Link device and the entered IO-Link master data before communication starts. Process data communication is only established if the configured values match the values reported by the device.

Replacement of the an IO-Link device of the same type is thus possible without changes in the Engineering Tool.

- Identical with entered values

In this case, the VendorID, DeviceID and serial number are synchronized after powering on between the IO-Link device and the entered IO-Link master data before communication starts. Process data communication is only established if the configured values match the values reported by the device.

Replacement of an IO-Link device of the same type is thus only possible if the serial number is changed in the Engineering Tool at the same time.

- VendorID

The VendorID of the IO-Link device used can be entered as a decimal value in the "VendorID (MSB)" (high-order byte) and "VendorID (LSB)" (low- order byte) fields.

- DeviceID

The DeviceID of the IO-Link device used can be entered as a decimal value in the "DeviceID (MSB)" (high-order byte) and "DeviceID (LSB)" (low-order byte) fields.

- Serial Number

The serial number of the IO-Link device can be entered as a string in the "Serial Number" input field. The input is limited to 16 characters.

■ **Fail Safe Behavior (for outputs only)**

This option is only applicable for IO-Link channels in COM mode where output data are used. In COM mode, the I/O data are exchanged between the IO-Link master and IO-Link device via serial communication.

► **Fail Safe Value Options**

The following values are selectable:

- Set Low

All bits of the output data with a value of 0 are transmitted to the IO-Link device. (Default setting).

- Set High

All bits of the output data with a value of 1 are transmitted to the IO-Link device.

- Hold Last

The last valid output value received by the control unit is continuously and cyclically transmitted to the IO-Link device.

- Replacement Value

If this option is selected, the values transferred via the "IO-Link failsafe parameter Object (Class-Code 0x81)" will be continuously and cyclically transmitted to the IO-Link device.

Refer the chapter "IO-Link failsafe parameter Object (Class-Code 0x81)" for transferring the replacement values to the IO-Link master.

- IO-Link Master command

The "IO-Link-Master-Command" option allows the use of IO-Link specific mechanisms for valid/invalid output process data. Thus, the device itself determines the behavior.

7 Connections

The LioN-P EtherNet/IP IO-Link Master supports different fixed I/O data connections.

With the input data, actual values are specified, and with the output data target values.

7.1 Exclusive Owner Connections

The Exclusive Owner connections can be configured as multicast or point to point connection in target to originator direction

► **Size of input data**

The amount of provider data (input data) is variable and depends from the chosen connection number.

The first block of data within the input data is always the status data block. This block contains the digital input states of the I/O ports, IO-Link port states and diagnosis data. The amount of input data depends from the configured IO-Link input/output data size.

► **Configured IO-Link input/output data size**

The IO-Link input/output data can be chosen in length of 4, 8, 16 or 32 bytes for all IO-Link channels in parallel. The length must be chosen for the maximal data length of all used IO-Link Devices on one IO-Link master. The chosen data length will be used for all IO-Link master ports in parallel for the input and output data size. This provides simple and constant data offsets in the input data stream with reduced input/output data amounts.

► **Configured extended IO-Link status data**

This block contains IO-Link communication states, parameter storage states and the IDs of the connected IO-Link Devices.

► **Configured IO-Link event data**

This block can contain up to three IO-Link Device event data sets.

For configuring the input/output data the following EtherNet/IP assembly couples are available: (Connection = CONN, Assembly = ASSY)

CONN No.	Input ASSY	Input data	Output ASSY
1	101	Status data of IO-Link Master (without IO-Link Device and opt. data)	100 (0 Byte IO-L)
2	103	Status data IO-L master + 4 Byte IO-L device per port	102 (4 Byte IO-L)
5	105	Status data IO-L master + 8 Byte IO-L device per port	104 (8 Byte IO-L)
8	107	Status data IO-L master + 16 Byte IO-L device per port	106 (16 Byte IO-L)
11	109	Status data IO-L master + 32 Byte IO-L device per port	108 (32 Byte IO-L)
3	111	Status data IO-L master + 4 Byte IO-L per port + extend. IO-Link state	102 (4 Byte IO-L)
6	113	Status data IO-L master + 8 Byte IO-L per port + extend. IO-Link state	104 (8 Byte IO-L)
9	115	Status data IO-L master + 16 Byte IO-L per port + extend. IO-Link state	106 (16 Byte IO-L)
12	117	Status data IO-L master + 32 Byte IO-L per port + extend. IO-Link state	108 (32 Byte IO-L)
4	F119	Status data IO-L master + 4 Byte IO-L per port + extend. IO-Link state + IO-L events	102 (4 Byte IO-L)
7	121	Status data IO-L master + 8 Byte IO-L per port + extend. IO-Link state + IO-L events	104 (8 Byte IO-L)
10	123	Status data IO-L master + 16 Byte IO-L per port + extend. IO-Link state + IO-L events	106 (16 Byte IO-L)
13	125	Status data IO-L master + 32 Byte IO-L per port + extend. IO-Link state + IO-L events	108 (32 Byte IO-L)

Table 19: Assembly couples input and output

Size of output data

The amount of consumer data (output data) is variable. The first block of data within the output data is always the control data block of the IO-Link master. This block contains the digital output control bits of the I/O ports.

The variable amount of output data depends from the

► Configured IO-Link input/output data size

The IO-Link output data can be chosen in length of 4, 8, 16 or 32 bytes for all IO-Link channels in parallel. The length must be chosen for the maximal data length of all used IO-Link Devices on one IO-Link master. The chosen data length will be used for all IO-Link master ports in parallel for the input and output data size. This provides simple and constant data offsets in the data stream.

For configuring the input/output data the following EtherNet/IP assembly couples are available: (Connection = CONN, Assembly = ASSY)

CONN No.	Input ASSY	Input data	Output ASSY
1	100	Status data of IO-Link Master (without IO-Link Device and opt. data)	100 (0 Byte IO-L)
2	102	4 byte IO-L master control data + 4 Byte IO-L device per port	103 (4 Byte IO-L)
3	102	4 byte IO-L master control data + 4 Byte IO-L device per port	111 (4 Byte IO-L + state)
4	102	4 byte IO-L master control data + 4 Byte IO-L device per port	119 (4 Byte IO-L + state + event)
5	104	4 byte IO-L master control data + 8 Byte IO-L device per port	105 (8 Byte IO-L)
6	104	4 byte IO-L master control data + 8 Byte IO-L device per port	113 (8 Byte IO-L + state)
7	104	4 byte IO-L master control data + 8 Byte IO-L device per port	121 (8 Byte IO-L + state + event)
8	106	4 byte IO-L master control data + 16 Byte IO-L device per port	107 (16 Byte IO-L)
9	106	4 byte IO-L master control data + 16 Byte IO-L device per port	115 (16 Byte IO-L + state)
10	106	4 byte IO-L master control data + 16 Byte IO-L device per port	123 (16 Byte IO-L + state + event)
11	108	4 byte IO-L master control data + 32 Byte IO-L device per port	109 (32 Byte IO-L)
12	108	4 byte IO-L master control data + 32 Byte IO-L device per port	117 (32 Byte IO-L + state)
13	108	4 byte IO-L master control data + 32 Byte IO-L device per port	125 (32 Byte IO-L + state + event)

Table 20: Assembly couples output and input

7.2 Listen Only Connections

Listen Only connections are available in multicast direction.

For configuring the input data as listen only connection the following EtherNet/IP assemblies are available:

(Connection = CONN, Assembly = ASSY)

CONN No.	Input ASSY	Input data	Output ASSY
14	100	Status data of IO-Link Master (without IO-Link Device and opt. data)	-
15	102	Status data IO-L master + 4 Byte IO-L device per port	-
16	102	Status data IO-L master + 8 Byte IO-L device per port	-
17	102	Status data IO-L master + 16 Byte IO-L device per port	-
18	104	Status data IO-L master + 32 Byte IO-L device per port	-

Table 21: Listen only connections

8 Bit assignment

With the input data, actual values are specified with the output data target values.

8.1 Status data of IO-Link Master (inputs)

Status data	Description
Byte 0	Status of digital inputs, port 1 – 4 (mapping mode 1, default)
Byte 1	Status of digital inputs, port 5 – 8 (mapping mode 1, default)
Byte 2	Status of IO-Link communication
Byte 3	Status of IO-Link process data validity
Byte 4	Status of module diagnostic (byte 0)
Byte 5	Status of module diagnostic (byte 1)
Byte 6	Status of sensor supply diagnostic, port 1 – 8
Byte 7	Reserved
Byte 8	Status of digital output diagnostic for channel A, port 1 – 8
Byte 9	Status of digital output diagnostic for channel B, port 5 – 8
Byte 10	Status of IO-Link Device diagnostic from type error, port 1 – 8
Byte 11	Status of IO-Link Device diagnostic from type warning, port 1 – 8
Byte 12	Status of IO-Link Device diagnostic from type notification, port 1 – 8
Byte 13	Reserved

Table 22: Status data of IO-Link Master

Refer the following chapter for the detailed information of input status data.

8.1.1 Status of digital inputs (mapping 1, default)

If mapping mode 1 was selected in the device configuration, the digital input data of the module are transferred as follows.

Byte 0	Digital input status of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X4	X4	X3	X3	X2	X2	X1	X1
Pin	2	4	2	4	2	4	2	4
Channel	4B	4A	3B	3A	2B	2A	1B	1A

Table 23: Byte 0, Status of digital inputs, mapping 1

Byte 1	Digital input status of ports 5 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X4	X4	X3	X3	X2	X2	X1	X1
Pin	2	4	2	4	2	4	2	4
Channel	8B	8A	7B	7A	6B	6A	5B	5A

Table 24: Byte 1, Status of digital inputs, mapping 1

The data in the cells highlighted in blue are available for LioN-P60 devices only. They are representing the physical output status.

8.1.2 Status of digital inputs (mapping 2)

If mapping mode 2 was selected in the device configuration, the digital input data of the module are transferred as follows.

Byte 0	Digital input status channel A of ports 1 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	4	4	4	4	4	4	4	4
Channel	8A	7A	6A	5A	4A	3A	2A	1A

Table 25: Byte 0, Status of digital inputs, mapping 2

Byte 1	Digital input status channel A of ports 1 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	2	2	2	2	2	2	2	2
Channel	8B	7B	6B	5B	4B	3B	2B	1B

Table 26: Byte 1, Status of digital inputs, mapping 2

The data in the cells highlighted in blue are available for LioN-P60 devices only. They are representing the physical output status.

8.1.3 Status of IO-Link communication

The "IOL-COM state" indicates whether the port has established a communication with the IO-Link device

Byte 2	IOL-COM state							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	4	4	4	4	4	4	4	4
Channel	8A	7A	6A	5A	4A	3A	2A	1A

Table 27: Byte 2, IOL-COM state

8.1.4 Status of IO-Link process data validity

The "IOL-PD valid" information indicates whether the IO-Link process data of the corresponding port are valid.

Byte 3	IOL-PD valid							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	4	4	4	4	4	4	4	4
Channel	8A	7A	6A	5A	4A	3A	2A	1A

Table 28: Byte 3, IOL-PD valid

8.1.5 Status of module diagnostic

This data delivers the collective information of the available module diagnosis.

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE

Table 29: Byte 4 - 5, Status of module diagnostic

- ▶ MI-LVS: Module information – system/sensor power supply low voltage
- ▶ MI-LVA: Module information – auxiliary power supply low voltage
- ▶ MI-SCS: Module information – sensor short-circuit
- ▶ MI-SCA: Module information – actuator short-circuit channel A
- ▶ MI-SCB: Module information – actuator short-circuit channel B
- ▶ MI-VAL: Module information – IO-Link validation error
- ▶ MI-FMA: Module information – Force mode active
- ▶ MI-DE: Module information – IO-Link device error
- ▶ MI-DW: Module information – IO-Link device warning
- ▶ MI-DN: Module information – IO-Link deviceink device notification

8.1.6 Status of sensor supply diagnostic

This data delivers the status information per port of the sensor supply diagnostic (pin 1 of X1 – X8).

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1

Table 30: Byte 6, Status of sensor supply diagnostic

- ▶ SCS-X1...SCS-X8: Sensor short-circuit at slot X1 to X8

8.1.7 Reserved (byte 7)

8.1.8 Status of digital output diagnostic

This data delivers the information per port of the digital output diagnosis for channel A and channel B. For LioN-P 60 modules the channel B information is also available if the port is configured as auxiliary supply.

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0

Table 31: Byte 8 - 9, Status of digital output diagnostic

- ▶ CE-X1A...CE-X8A:
Channel error, channel A (contact pin 4) of slots X1 to X8
- ▶ CE-X5B...CE-X8B:
Channel error, channel B (contact pin 2) of slots X1 to X8

8.1.9 Status of module diagnostic

This data delivers the information per port if an IO-Link device has sent an **error**, **warning** or **notification** message.

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8A	VAL-X7A	VAL-X6A	VAL-X5A	VAL-X4A	VAL-X3A	VAL-X2A	VAL-X1A

Table 32: Byte 10 - 13, Status of IO-Link Device diagnostic

- ▶ DE-X1A...DE-X8A: IO-Link device **error** message, channel A (contact pin 4, C/Q) of slots X1 to X8
- ▶ DW-X1A...DW-X8A: IO-Link device **warning** message, channel A (contact pin 4, C/Q) of slots X1 to X8
- ▶ DN-X1A...DN-X8A: IO-Link device **notification** message, channel A (contact pin 4, C/Q) of slots X1 to X8
- ▶ VAL-X1A...VAL-X8A: IO-Link Master **validation error**, channel A (contact pin 4, C/Q) of slots X1 to X8

8.2 IO-Link Device input data

Depending of the chosen input assembly

- ▶ 103: 4 byte IO-Link input
- ▶ 105: 8 byte IO-Link input
- ▶ 107: 16 byte IO-Link input
- ▶ 109: 32 byte IO-Link input

- ▶ 111: 4 byte IO-L input + 8 byte extended IO-Link status
- ▶ 113: 8 byte IO-L input + 8 byte extended IO-Link status
- ▶ 115: 16 byte IO-L input + 8 byte extended IO-Link status
- ▶ 117: 32 byte IO-L input + 8 byte extended IO-Link status

- ▶ 119: 4 byte IO-L input+8 byte ext. IO-L status+12 byte IO-Link event
- ▶ 121: 8 byte IO-L input+8 byte ext. IO-L status+12 byte IO-Link event
- ▶ 123: 16 byte IO-L input+8 byte ext. IO-L status+12 byte IO-Link event
- ▶ 125: 32 byte IO-L input+8 byte ext. IO-L status+12 byte IO-Link event

data will be added for every IO-Link port to the producer data at address offset 14. The received IO-Link device input data will be transferred to the EtherNet/IP controller without byte swapping.

8.2.1 IO-Link data for 4 byte input, assembly 103

The assembly 103 provides 4 byte IO-Link input data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 17	X1	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 18 - 21	X2	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 22 - 25	X3	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 26 - 29	X4	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 30 - 33	X5	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 34 - 37	X6	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 38 - 41	X7	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 42 - 45	X8	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data

Table 33: Byte 14 - 45, Input data for input assembly 103

The 4 byte input data per port are zero, if no IO-Link device is connected to the appropriate port.

8.2.2 IO-Link data for 8 byte input, assembly 105

The assembly 105 provides 8 byte IO-Link input data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 21	X1	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 22 - 29	X2	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 30 - 37	X3	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 38 - 45	X4	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 46 - 53	X5	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 54 - 61	X6	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 62 - 69	X7	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 70 - 78	X8	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data

Table 34: Byte 14 - 78, Input data for input assembly 105

The 8 byte input data per port are zero, if no IO-Link device is connected to the appropriate port.

8.2.3 IO-Link data for 16 byte input, assembly 107

The assembly 107 provides 8 byte IO-Link input data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 29	X1	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 30 - 45	X2	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 46 - 61	X3	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 62 - 77	X4	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 78 - 93	X5	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 94 - 109	X6	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 110 - 125	X7	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 126 - 141	X8	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data

Table 35: Byte 14 - 141, Input data for input assembly 107

The 16 byte input data per port are zero, if no IO-Link device is connected to the appropriate port.

8.2.4 IO-Link data for 32 byte input, assembly 109

The assembly 109 provides 32 byte IO-Link input data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 45	X1	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 46 - 77	X2	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 78 - 109	X3	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 110 - 141	X4	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 142 - 173	X5	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 174 - 205	X6	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 206 - 237	X7	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 238 - 269	X8	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data

Table 36: Byte 14 - 269, Input data for input assembly 109

The 32 byte input data per port are zero, if no IO-Link device is connected to the appropriate port.

8.3 IO-Link input & extended IO-Link status data

Depending of the chosen input assembly

- ▶ 111: 4 byte IO-L input + 8 byte extended IO-Link status
- ▶ 113: 8 byte IO-L input + 8 byte extended IO-Link status
- ▶ 115: 16 byte IO-L input + 8 byte extended IO-Link status
- ▶ 117: 32 byte IO-L input + 8 byte extended IO-Link status

data will be added for every IO-Link port to the producer data at address offset 14. The received IO-Link device input data will be transferred to the EtherNet/IP controller without byte swapping.

The extended IO-Link status data are defined as follows:

Byte	Bit	Description
0	7	Reserved
	6	Reserved
	5	Reserved
	4	Reserved
	3	Reserved
	2	Reserved
	1	1 = Communication with IO-Link Device available
	0	1 = Port in IO-Link mode configured
1	7	Reserved
	6	Reserved
	5	Reserved
	4	Reserved
	3	1 = IO-Link Device detected and serial number identical
	2	1 = Detected IO-Link Device incompatible (VendorID or DeviceID)
	1	1 = Parameter storage error
	0	1 = Direct parameter page not plausible
2		Vendor ID (LSB)
3		Vendor ID (MSB)
4		Device ID (LSB)
5		Device ID
6		Device ID (MSB)
7		Reserved

Table 37: Byte 0 - 7, Extended IO-Link status data

8.3.1 IO-Link 4 byte input & ext. status, assembly 111

The assembly 111 provides 4 byte IO-Link input and 8 byte extended IO-Link status data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 17	X1	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 18 - 25	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 26 - 29	X2	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 30 - 37	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 38 - 41	X3	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 42 - 49	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 50 - 53	X4	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 54 - 61	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 62 - 65	X5	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 66 - 73	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 74 - 77	X6	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 78 - 85	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 86 - 89	X7	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 90 - 97	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 98 - 101	X8	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 102 - 109	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status

Table 38: Byte 14 - 109, Input data for input assembly 111

The 4 byte input and extended IO-Link status data per port are zero, if no IO-Link device is connected to the appropriate port.

8.3.2 IO-Link 8 byte input & ext. status, assembly 113

The assembly 111 provides 4 byte IO-Link input and 8 byte extended IO-Link status data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 21	X1	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 22 - 29	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 30 - 37	X2	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 38 - 45	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 46 - 53	X3	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 54 - 61	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 62 - 69	X4	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 70 - 77	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 78 - 85	X5	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data

Table 39: Byte 14 - 141, Input data for input assembly 113

Input	Port	Description
Byte 86 - 96	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 94 - 101	X6	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 102 - 109	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 110 - 117	X7	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 118 - 125	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 126 - 133	X8	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 134 - 141	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status

Table 39: Byte 14 - 141, Input data for input assembly 113

The 8 byte input and extended IO-Link status data per port are zero, if no IO-Link device is connected to the appropriate port.

8.3.3 IO-Link 16 byte input & ext. status, assembly 115

The assembly 115 provides 16 byte IO-Link input and 8 byte extended IO-Link status data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 29	X1	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 30 - 37	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 38 - 53	X2	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 54 - 61	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 62 - 77	X3	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 78 - 85	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 86 - 101	X4	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 102 - 109	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 110 - 125	X5	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 126 - 133	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 134 - 149	X6	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 150 - 157	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 158 - 173	X7	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 174 - 181	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 182 - 189	X8	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 190 - 197	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status

Table 40: Byte 14 - 197, Input data for input assembly 115

The 16 byte input and extended IO-Link status data per port are zero, if no IO-Link device is connected to the appropriate port.

8.3.4 IO-Link 32 byte input & ext. status, assembly 117

The assembly 117 provides 32 byte IO-Link input and 8 byte extended IO-Link status data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 45	X1	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 46 - 53	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 54 - 85	X2	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 86 - 93	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 94 - 125	X3	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 126 - 133	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 134 - 165	X4	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 166 - 173	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 174 - 205	X5	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 206 - 213	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 214 - 245	X6	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 246 - 253	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 254 - 285	X7	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 286 - 293	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 294 - 325	X8	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 326 - 333	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status

Table 41: Byte 14 - 333, Input data for input assembly 115

The 32 byte input and extended IO-Link status data per port are zero, if no IO-Link device is connected to the appropriate port.

8.4 IO-Link input & ext. IO-Link status & IO-Link event

Depending of the chosen input assembly

- ▶ 119: 4 byte IO-L input + 8 byte ext. IO-L status + IO-Link event data
- ▶ 121: 8 byte IO-L input + 8 byte ext. IO-L status + IO-Link event data
- ▶ 123: 16 byte IO-L input + 8 byte ext. IO-L status + IO-Link event data
- ▶ 125: 32 byte IO-L input + 8 byte ext. IO-L status + IO-Link event data

data will be added for every IO-Link port to the producer data at address offset 14. The received IO-Link device input data will be transferred to the EtherNet/IP controller without byte swapping.

The extended IO-Link status data are defined as follows:

Byte	Bit	Description
0	1	Event Qualifier
1	1	Event Code 1 (LSB)
2	1	Event Code 2 (MSB)
3	1	Reserved
4	2	Event Qualifier
5	2	Event Code 1 (LSB)
6	2	Event Code 2 (MSB)
7	2	Reserved
8	3	Event Qualifier
9	3	Event Code 1 (LSB)
10	3	Event Code 2 (MSB)
11	3	Reserved

Table 42: IO-Link event block

This data block can contain up to three event messages of the connected IO-Link device. Event 1 shows always the latest event messages, former event messages will be shifted to event block two or three. The event data will be cleared only after a power cycle of the IO-Link master.

■ Event Qualifier

	Mode		Type		Res.	Instance		
Bit	7	6	5	4	3	2	1	0

Table 43: Event qualifier

► Event Qualifier Instance:

Value	Definition
0	Unknown
1	Phy.
2	DL
3	AL
4	Application
5 ... 7	reserved

Table 44: Event qualifier instance

► Event Qualifier Res.:

This bit is reserved and must be set to 0.

► Event Qualifier Type:

Value	Definition
0	Reserved
1	Information
2	Warning
3	Error

Table 45: Event qualifier type

► Event Qualifier Mode:

Value	Definition
0	Reserved
1	Event single shot

Table 46: Event qualifier mode

Value	Definition
2	Event disappears
3	Event appears

Table 46: *Event qualifier mode*

■ Event Code 1 and 2

Diagnostic code reported by the IO-Link device. Use the IO-Link device documentation to interpret the error message.

8.4.1 IO-L 4 byte & status & event data, assembly 119

The assembly 119 provides 4 byte IO-Link input, 8 byte extended IO-Link status and 8 byte IO-Link event data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 17	X1	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 18 - 25	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 26 - 33	X1	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 35 - 37	X2	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 38 - 45	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 46 - 53	X2	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 54 - 57	X3	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 58 - 65	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 66 - 73	X3	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 74 - 77	X4	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 78 - 85	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 86 - 93	X4	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 94 - 97	X5	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 98 - 105	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 106 - 113	X5	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 114 - 117	X6	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 118 - 125	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 126 - 133	X6	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 134 - 137	X7	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 138 - 145	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 146 - 153	X7	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 154 - 157	X8	Byte 0 of IO-Link input data - Byte 3 of IO-Link input data
Byte 158 - 165	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 166 - 173	X8	Byte 0 of IO-L event data - Byte 7 of IO-L event data

Table 47: Byte 14 - 173, Input data for input assembly 119

The 4 byte input, extended IO-Link status and IO-Link event data per port are zero, if no IO-Link device is connected to the appropriate port

8.4.2 IO-L 8 byte & status & event data, assembly 121

The assembly 121 provides 8 byte IO-Link input, 8 byte extended IO-Link status and 8 byte IO-Link event data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 21	X1	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 22 - 29	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 30 - 37	X1	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 38 - 45	X2	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 46 - 53	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 54 - 61	X2	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 62 - 69	X3	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 70 - 77	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 78 - 85	X3	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 86 - 93	X4	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 94 - 101	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 102 - 109	X4	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 110 - 117	X5	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 118 - 125	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 126 - 133	X5	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 134 - 141	X6	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 142 - 149	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 150 - 157	X6	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 158 - 165	X7	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 166 - 173	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 174 - 181	X7	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 182 - 189	X8	Byte 0 of IO-Link input data - Byte 7 of IO-Link input data
Byte 190 - 197	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 198 - 205	X8	Byte 0 of IO-L event data - Byte 7 of IO-L event data

Table 48: Byte 14 - 205, Input data for input assembly 121

The 8 byte input, extended IO-Link status and IO-Link event data per port are zero, if no IO-Link device is connected to the appropriate port.

8.4.3 IO-L 16 byte & status & event data, assembly 123

The assembly 123 provides 16 byte IO-Link input, 8 byte extended IO-Link status and 8 byte IO-Link event data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 17	X1	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 30 - 37	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 38 - 45	X1	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 46 - 61	X2	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 62 - 69	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 70 - 77	X2	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 78 - 93	X3	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 94 - 101	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 102 - 109	X3	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 110 - 125	X4	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 126 - 133	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 134 - 141	X4	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 142 - 157	X5	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 158 - 165	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 166 - 173	X5	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 174 - 189	X6	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 190 - 197	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 198 - 205	X6	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 206 - 221	X7	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 222 - 229	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 230 - 237	X7	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 238 - 253	X8	Byte 0 of IO-Link input data - Byte 15 of IO-Link input data
Byte 254 - 261	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 262 - 269	X8	Byte 0 of IO-L event data - Byte 7 of IO-L event data

Table 49: Byte 14 - 269, Input data for input assembly 123

The 16 byte input, extended IO-Link status and IO-Link event data per port are zero, if no IO-Link device is connected to the appropriate port.

8.4.4 IO-L 32 byte & status & event data, assembly 125

The assembly 125 provides 32 byte IO-Link input, 8 byte extended IO-Link status and 8 byte IO-Link event data for every IO-Link port with the following mapping:

Input	Port	Description
Byte 14 - 45	X1	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 46 - 53	X1	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 54 - 61	X1	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 62 - 93	X2	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 94 - 101	X2	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 102 - 109	X2	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 110 - 141	X3	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 142 - 149	X3	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 150 - 157	X3	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 158 - 189	X4	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 190 - 197	X4	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 198 - 205	X4	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 206 - 237	X5	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 238 - 245	X5	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 246 - 253	X5	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 254 - 285	X6	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 286 - 293	X6	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 294 - 301	X6	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 302 - 333	X7	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 334 - 341	X7	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 342 - 349	X7	Byte 0 of IO-L event data - Byte 7 of IO-L event data
Byte 350 - 381	X8	Byte 0 of IO-Link input data - Byte 31 of IO-Link input data
Byte 382 - 389	X8	Byte 0 of ext. IO-L status - Byte 7 of ext. IO-L status
Byte 390 - 397	X8	Byte 0 of IO-L event data - Byte 7 of IO-L event data

Table 50: Byte 14 - 397, Input data for input assembly 125

The 32 byte input, extended IO-Link status and IO-Link event data per port are zero, if no IO-Link device is connected to the appropriate port.

8.5 Control data of IO-Link Master (outputs)

For configuring the output data the following EtherNet/IP consuming assemblies are available:

Assembly	Output data
100	4 byte IO-L master control data (without IO-Link Device output data)
102	4 byte IO-L master control data + 4 Byte IO-L device per port
104	4 byte IO-L master control data + 8 Byte IO-L device per port
106	4 byte IO-L master control data + 16 Byte IO-L device per port
108	4 byte IO-L master control data + 32 Byte IO-L device per port

Table 51: Output assemblies

The digital output on the corresponding port can be controlled via the IO-Link master control data. The I/O link port must be parametrized as a digital output in the engineering tool.

The IO-Link master consumes in every used consuming assembly configuration the following control data of the IO-Link master digital outputs:

8.5.1 Control of digital outputs (mapping 1, default) Exclusion: 0980 ESL 3x8-121

If mapping mode 1 was selected in the IO-Link master parametrization, the digital output data of the module are transferred as follows.

Byte 0	Control data for digital outputs of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X4	X4	X3	X3	X2	X2	X1	X1
Pin	-	4	-	4	-	4	-	4
Channel	-	4A	-	3A	-	2A	-	1A

Table 52: Byte 0, Status of digital outputs, mapping 1

Byte 1	Control data for digital outputs of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X4	X4	X3	X3	X2	X2	X1	X1
Pin	2	4	2	4	2	4	2	4
Channel	4B	4A	3B	3A	2B	2A	1B	1A

Table 53: Byte 1, Status of digital outputs, mapping 1

- The data in the cells highlighted in blue are only available for LioN-P 60 devices.

8.5.2 Control of digital outputs (mapping 2, E2C-comp.) Exclusion: 0980 ESL 3x8-121

If mapping mode 2 was selected in the IO-Link master parametrization, the digital output data of the module are transferred as follows.

Byte 0	Control data for digital outputs channel A of ports 1 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	4	4	4	4	4	4	4	4
Channel	8A	7	6A	5A	4A	3A	2A	1A

Table 54: Byte 0, Status of digital outputs for mapping 2

Byte 1	Control data for digital outputs channel A of ports 1 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	2	2	2	2	-	-	-	-
Channel	8B	7B	6B	5B	-	-	-	-

Table 55: Byte 1, Status of digital outputs for mapping 2

► The data in the cells highlighted in blue are only available for LioN-P 60 devices.

8.5.3 Control of digital outputs for 0980 ESL 3x8-121 (mapping 1, default)

If mapping mode 1 was selected in the IO-Link master parametrization, the digital output data of the module are transferred as follows.

Byte 0	Control data for digital outputs of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X4	X4	X3	X3	X2	X2	X1	X1
Pin	-	-	-	-	-	-	-	-
Channel	-	-	-	-	-	-	-	-

Table 56: Byte 0, Status of digital outputs for mapping 1

Byte 1	Control data for digital outputs of ports 5 - 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X8	X7	X7	X6	X6	X5	X5
Pin	2	-	2	-	2	-	2	-
Channel	8B	-	7B	-	6B	-	5B	-

Table 57: Byte 1, Status of digital outputs for mapping 1

8.5.4 Control of digital outputs for 0980 ESL 3x8-121 (mapping 2)

If mapping mode 2 was selected in the IO-Link master parametrization, the digital output data of the module are transferred as follows.

Byte 0	Control data for digital outputs of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	-	-	-	-	-	-	-	-
Channel	-	-	-	-	-	-	-	-

Table 58: Byte 0, Status of digital outputs for mapping 2

Byte 1	Control data for digital outputs of ports 5 – 8							
Bit	7	6	5	4	3	2	1	0
Port	X8	X8	X7	X7	X6	X6	X5	X5
Pin	2	2	2	2	-	-	-	-
Channel	8B	7B	6B	5B	-	-	-	-

Table 59: Byte 1, Status of digital outputs for mapping 2

8.5.5 Control of IO-Link COM mode

This mode can be used to temporarily (as long as the corresponding COM control bit is set) switch one or more IO-Link ports previously in digital input (DI) operating mode to IO-Link operating mode. As a result, it is possible to establish communications with the connected IO-Link device for parameterization. No process data are exchanged during this time.

Byte 2	Control data for digital outputs of ports 1 - 4							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	4	4	4	4	4	4	4	4
Channel	8A	7A	6A	5A	4A	3A	2A	1A

Table 60: Byte 0, Control of IO-Link COM mode

8.5.6 Reserved

Byte 3	Reserved, do not use							
Bit	7	6	5	4	3	2	1	0
Port	X8	X7	X6	X5	X4	X3	X2	X1
Pin	-	-	-	-	-	-	-	-
Channel	-	-	-	-	-	-	-	-

Table 61: Byte 0, Reserved control byte

8.6 Control data of IO-Link Device (outputs)**8.6.1 IO-Link Device 4 byte output, assembly 102**

The assembly 102 provides 4 byte IO-Link output data (master to device) for every IO-Link port with the following mapping:

Input	Port	Description
Byte 4 - 7	X1	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 8 - 11	X2	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 12 - 15	X3	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 16 - 19	X4	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 20 - 23	X5	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 24 - 27	X6	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 28 - 31	X7	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data
Byte 32 - 35	X8	Byte 0 of IO-Link output data - Byte 3 of IO-Link output data

Table 62: Byte 4 - 35, Output data for assembly 102

8.6.2 IO-Link Device 8 byte output, assembly 104

The assembly 102 provides 4 byte IO-Link output data (master to device) for every IO-Link port with the following mapping:

Input	Port	Description
Byte 4 - 11	X1	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 12 - 19	X2	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 20 - 27	X3	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 28 - 35	X4	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 36 - 43	X5	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 44 - 51	X6	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data

Table 63: Byte 4 - 67, Output data for assembly 104

Input	Port	Description
Byte 52 - 59	X7	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data
Byte 60 - 67	X8	Byte 0 of IO-Link output data - Byte 7 of IO-Link output data

Table 63: Byte 4 - 67, Output data for assembly 104

8.6.3 IO-Link Device 8 byte output, assembly 104

The assembly 106 provides 16 byte IO-Link output data (master to device) for every IO-Link port with the following mapping:

Input	Port	Description
Byte 4 - 19	X1	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 20 - 35	X2	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 36 - 51	X3	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 52 - 67	X4	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 68 - 83	X5	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 84 - 99	X6	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 100 - 115	X7	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 116 - 131	X8	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data

Table 64: Byte 4 - 131, Output data for assembly 106

8.6.4 IO-Link Device 32 byte output, assembly 108

The assembly 108 provides 32 byte IO-Link output data (master to device) for every IO-Link port with the following mapping:

Input	Port	Description
Byte 4 - 35	X1	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 36 - 67	X2	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 68 - 99	X3	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 100 - 131	X4	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 132 - 163	X5	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 164 - 195	X6	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 196 - 227	X7	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data
Byte 228 - 259	X8	Byte 0 of IO-Link output data - Byte 15 of IO-Link output data

Table 65: Byte 4 - 259, Output data for assembly 108

9 Diagnostics processing

9.1 Error in the system/sensor power supply

The voltage value for the incoming system/sensor power supply is also monitored globally. If the voltage drops below approx. 18,6 V, or exceeds approx. 30 V, an error message is generated.

The green U_S indicator is unlit.

The error message has no effect on the outputs.



Caution

It must definitely be ensured that the supply voltage, measured at the most remote participant is not below 18 V DC from the perspective of the system power supply.

The following table shows the used diagnosis bits in the status data of the IO-Link master:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 66: Status of module diagnostic MI-LVS

9.2 Error in auxiliary/actuator power supply

The voltage value for the incoming auxiliary/actuator power supply is also monitored globally. If U_{Aux} diagnostic messaging is enabled, an error message is generated if the voltage drops below approx. 18,6 V or exceeds approx. 30 V.

The U_{Aux} indicator shows red.

If output channels are enabled, additional error messages caused by the voltage failure are generated on the I/O ports.

U_{Aux} diagnostic messaging is disabled by default and must be enabled via parameterization.

The following table shows the used diagnosis bits in the status data of the IO-Link master:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 67: Status of module diagnostic MI-LVA

9.3 Overload/short-circuit of the I/O port sensor supply outputs

In case of an overload or a short circuit between pin 1 and pin 3 on the ports (X1 - X8), the following channel-specific diagnostic messages are generated:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 68: Status of module diagnostic MI-SCS

9.4 Overload/short circuit of the digital 500 mA outputs

The digital outputs on the C/Q pin (except 0980 ESL 3x8-121) are short circuit and overload protected. In case of a fault, the output is automatically switched off and cyclically automatically switched back on.

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 69: Status of module diagnostic MI-SCA

9.5 Overload/short circuit of the digital 2.0 A outputs

There are four 2.0 A (1,6 A for 0980 ESL 3x8-121) outputs on the Class B ports of the LioN-P 60 devices.

A channel error is determined by comparing the target value set by a controller and the actual value of an output channel.

Target value	Actual value	Comment
Active	Active	OK, no diagnosis
Off	Off	OK, no diagnosis
Active	Off	Short-circuit Channel indicator is red. Channel error bit in the diagnosis is set. Channel is locked after the error is rectified.

Table 70: Interpretation of channel errors

When an output channel is activated (rising edge of the channel state) or deactivated (falling edge), the channel errors are filtered for the period that you set using the "Surveillance-Timeout" parameter during the configuration of the module. The value of this parameter can range from 0 to 255 ms; the factory setting is 80 ms.

The filter is used to avoid premature error messages when a capacitive load is activated or an inductive load is deactivated, and during other voltage peaks when a status changes.

In static state of the output channel, that is, while the channel is permanently switched on or off, the filter time between error detection and the diagnostic message is typically 5-10 ms.

The following table shows the used diagnosis bits in the status data of the IO-Link master:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0

Table 71: Status of module diagnostic MI-SCB

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 71: Status of module diagnostic MI-SCB

9.6 Overload/short circuit of the type B port aux. power supply

9.6.1 For LioN-P 30 devices

In case of an overload or a short circuit between pin 2 and pin 5 on these ports (X5 - X8), the following diagnosis bits in the status data of the IO-Link master can be set:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 72: Status of module diagnostic MI-SCB for LioN-P 30

9.6.2 For LioN-P 60 devices

In case of an overload or a short circuit between pin 2 and pin 5 on these ports (X5 - X8), the following group diagnostic message (not channel-specific) is generated in the status data of the IO-Link master:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 73: Status of module diagnostic MI-SCB in aux. power supply mode

9.7 IO-Link Master error

9.7.1 IO-Link C/Q error

If an IO-Link device in COM mode is unplugged, or an electrical fault occurs on the C/Q (Pin 4) line, for example, due to a short circuit, then following diagnosis bits can be set in the IO-Link master status data:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 74: Status of module diagnostic MI-SCA

9.7.2 IO-Link validation error

If an IO-Link device in COM mode is unplugged (and the validation is parameterized), a validation error is detected, e.g. by wrong Vendor ID or Device ID, then the following diagnosis bits can be set in the IO-Link master status data:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	0	0	0	0	0	0	0	0
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 75: Status of module diagnostic MI-VAL

9.8 IO-Link device diagnostics

Diagnosis of IO-Link devices can have the level error, warning or notification.

9.8.1 IO-Link Device error

In case of an error diagnosis send from device to master, the following diagnosis bits can be set in the IO-Link master status data:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 76: Status of module diagnostic IOL-DE

9.8.2 IO-Link Device warning

In case of a warning diagnosis send from device to master, the following diagnosis bits can be set in the IO-Link master status data:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 77: Status of module diagnostic IOL-DW

9.8.3 IO-Link Device warning

In case of a warning diagnosis send from device to master, the following diagnosis bits can be set in the IO-Link master status data:

Input	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 4	0	MI-FMA	MI-VAL	MI-SCB	MI-SCA	MI-SCS	MI-LVA	MI-LVS
Byte 5	0	0	0	0	0	IOL-DN	IOL-DW	IOL-DE
Byte 6	SCS-X8	SCS-X7	SCS-X6	SCS-X5	SCS-X4	SCS-X3	SCS-X2	SCS-X1
Byte 7	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8	VAL-X8
Byte 8	CE-X8A	CE-X7A	CE-X6A	CE-X5A	CE-X4A	CE-X3A	CE-X2A	CE-X1A
Byte 9	CE-X8B	CE-X7B	CE-X6B	CE-X5B	0	0	0	0
Byte 10	DE-X8A	DE-X7A	DE-X6A	DE-X5A	DE-X4A	DE-X3A	DE-X2A	DE-X1A
Byte 11	DW-X8A	DW-X7A	DW-X6A	DW-X5A	DW-X4A	DW-X3A	DW-X2A	DW-X1A
Byte 12	DN-X8A	DN-X7A	DN-X6A	DN-X5A	DN-X4A	DN-X3A	DN-X2A	DN-X1A
Byte 13	VAL-X8	VAL-X7	VAL-X6	VAL-X5	VAL-X4	VAL-X3	VAL-X2	VAL-X1

Table 78: Status of module diagnostic IOL-DN

10 EtherNet/IP objects

The following EtherNet/IP objects are supported by the device:

- ▶ Identity Object (Class-Code 0x01)
- ▶ Assembly Object (Class-Code 0x04)
- ▶ Connection Manager Object (Class-Code 0x06)
- ▶ EtherNet/IP Link Object (Class-Code 0xF6)
- ▶ TCP/IP Object (Class-Code 0xF5)
- ▶ Quality of Service Object (Class-Code 0x48)
- ▶ DLR Object (Class-Code 0x47)
- ▶ IO-Link Device Parameter Object (Class-Code 0x80), vendor specific
- ▶ IO-Link Failsafe Parameter Object (Class-Code 0x81), vendor specific

10.1 IO-Link Device parameter object (Class Code 0x80)

This vendor specific object supports reading or writing of IO-Link Device parameter.

10.1.1 Read ISDU service (Class Code 0x80)

The read ISDU service request parameter are defined as follows

Name	Value	Type	Description
Class	0x80		IO-Link Device parameter object
Instance	1		IO-Link Master
Instance Attribute	1 - 8		IO-Link port number
Service Code	0x4B		READ ISDU code
Index	¹⁾	UINT	IO-Link ISDU object index
Sub Index	¹⁾	USINT	IO-Link ISDU object sub-index

Table 79: 0x80 Read ISDU request

¹⁾ Depends from the connected IO-Link Device, refer to the IO-Link Device documentation.

If the read request was successful ('General Status' of the CIP response is 0), the following **response** format is available.

Name	Type	Description
ISDU	Array of Byte	Max. 232 bytes

Table 80: General status of CIP response equal 0

If the read request was not successful ('General Status' of the CIP response is unequal 0), the following **response** format is available:

Name	Type	Error Code	Description	Error Code
IO-Link Master Error	UINT		Service not available	1
			Port blocked	2
			Timeout	3
			Invalid index	4
			Invalid sub-index	5
			Wrong port	6
			Wrong port function	7
			Invalid length	8
			ISDU not supported	9
IO-Link Device Error	USINT		Refer to IO-Link specification	-
IO-Link Device Additional Error	USINT		Refer to IO-Link specification	-

Table 81: 0x80 Read ISDU negative

10.1.2 Write ISDU service (Class Code 0x80)

The write ISDU service request parameter are defined as follows:

Name	Value	Type	Description
Class	0x80		IO-Link Device parameter object
Instance	1		IO-Link Master
Instance Attribute	1 - 8		IO-Link port number
Service Code	0x4C		Write ISDU code
Index	¹⁾	UINT	IO-Link ISDU object index
Sub Index	¹⁾	USINT	IO-Link ISDU object sub-index
Data	¹⁾	Array of Bytes	IO-Link ISDU data, max. 232 bytes

Table 82: 0x80 Write ISDU request

¹⁾ Depends from the connected IO-Link Device, refer to the IO-Link Device documentation.

If the write request was successful the 'General Status' of the CIP response is 0.

If the read request was not successful ('General Status' of the CIP response is unequal 0), the following response format is available:

Name	Type	Error Code Description	Error Code
IO-Link Master Error	UINT	Service not available	1
		Port blocked	2
		Timeout	3
		Invalid index	4
		Invalid sub-index	5
		Wrong port	6
		Wrong port function	7
		Invalid length	8
		ISDU not supported	9
IO-Link Device Error	USINT	Refer to IO-Link specification	-
IO-Link Device Additional Error	USINT	Refer to IO-Link specification	-

Table 83: 0x80 Write ISDU request negative

10.2 IO-Link failsafe parameter Object (Class-Code 0x81)

In case of an EtherNet/IP communication loss, failsafe values can be defined for the IO-Link Device output data.

If in the IO-Link Port Parameter settings the option "Replacement Value" was set, then the substitute value transferred by this Class-Code 0x81 will be transferred as output data to the IO-Link Device. The values must be written into the IO-Link master after every power on cycle.

The value must be entered as in MSB to LSB byte order, depending on the configured data length and used IO-Link Device.

10.2.1 Set failsafe parameter (Class Code 0x81)

The set failsafe service **request** parameters are defined as follows:

Name	Value	Type	Description
Class	0x80		IO-Link Device parameter object
Instance	1		IO-Link Master failsafe
Instance Attribute	1 - 8		IO-Link port number
Service Code	0x10		Set attribute single
Data	¹⁾	Array of Bytes	Failsafe value of IO-Link port

Table 84: 0x81 Set failsafe parameter

¹⁾ Depends from the connected IO-Link Device, refer to the IO-Link Device documentation.

If the write request was successful the "General Status" of the CIP response is 0.

10.2.2 Get failsafe parameter (Class Code 0x81)

The get failsafe service **request** parameters are defined as follows:

Name	Value	Type	Description
Class	0x81		IO-Link Device parameter object
Instance	1		IO-Link Master failsafe
Instance Attribute	1 - 8		IO-Link port number
Service Code	0x0E		Get attribute single
Data	¹⁾	Array of Bytes	Failsafe value of IO-Link port

Table 85: 0x81 Get failsafe parameter


¹⁾ Depends from the connected IO-Link Device, refer to the IO-Link Device documentation.

If the get request was successful the "General Status" of the CIP response is 0.

11 The integrated web server

The LioN-P modules are equipped with an integrated web server which makes functions available for the configuration of modules and display of status and diagnostic information.

Enter `http://` followed by the IP address, such as `http://192.168.1.5`, in your web browser's address bar. If the Home page of the module is not displayed, check your browser and firewall settings.

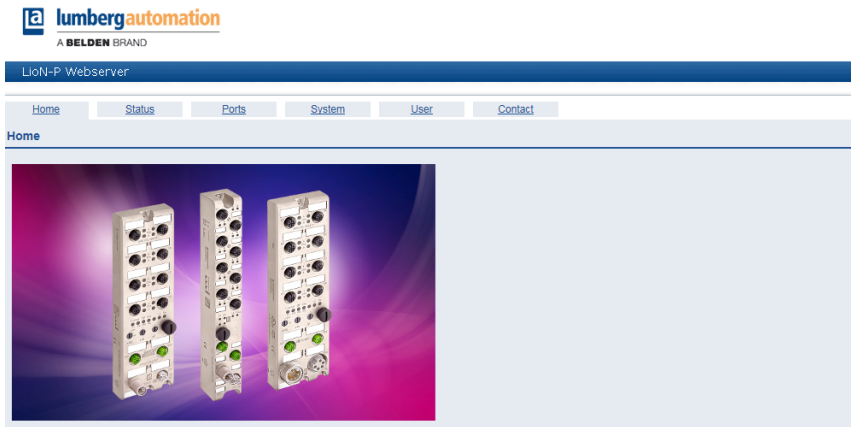

The web interface provides an overview of the configuration and status of the module. Also, certain settings can be made. It is also possible to use the web interface to trigger a reboot, reset to the factory defaults, or perform a firmware update.

11.1 The Status page



A BELDEN BRAND

LioN-P Webserver

Home

Status

Ports


System

User

Contact

Status

Device Overview

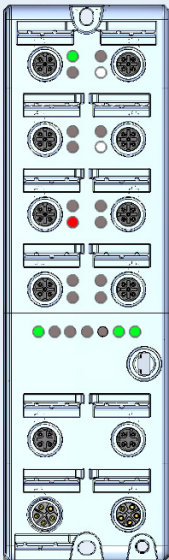

Device Information

Name	0980 ESL 319-121
Bus	ON
Device Diagnosis	
IO-Link Master Diagnosis	
Forcemode	Forcemode locked

Port Information

Port	Type	Pin / Channel	Function	State	Dia	Details
X1	IO-Link Class A + Di	4 / A	IO-Link 0 Bytes in, 2 Bytes Out	Operate		ⓘ
		2 / B	Digital Input 1 Bit in / NO	OFF		
X2	IO-Link Class A + Di	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	Digital Input 1 Bit in / NO	OFF		
X3	IO-Link Class A + Di	4 / A	Digital Input 1 Bit in / NO	OFF	DIA	ⓘ
		2 / B	Digital Input 1 Bit in / NO	OFF		
X4	IO-Link Class A + Di	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	Digital Input 1 Bit in / NO	OFF		
X5	IO-Link Class B + DO	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	Digital Output 1 Bit Out	ON		
X6	IO-Link Class B + DO	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	Digital Output 1 Bit Out	ON		
X7	IO-Link Class B + DO	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	AUX Power			
X8	IO-Link Class B + DO	4 / A	Digital Input 1 Bit in / NO	OFF		ⓘ
		2 / B	AUX Power			

The status page provides a quick overview of the current state of the module.

The left side shows a graphical representation of the module with all its LEDs and the positions of the rotary encoding switches.

The right side shows the "Device Information" table with some basic data for the module; for example, the variant, the cyclic communication status and a diagnostic indicator. The indicator shows whether a diagnosis for the module exists.

The "Port Information" table shows the configuration and state of all the module's I/O ports.

Column	Information
Port	Name of port
Type	Type of port. This can be DIO, IOL A or IOL B depending on the variant. The +DO supplement indicates that an additional 2 A output is available here.
Pin	Corresponding pin on the M8/M12 slot
Function	Function configured via control
State	Current status. ON or OFF is displayed here for digital inputs or outputs. The COM status is displayed for IO-Link connections.
Dia	The diagnostics indicator shows whether a diagnosis exists for this channel.
Details	This link can be used to jump directly to the corresponding detailed view for this port. More information is then available.

Table 86: Web server status description



WARNING

Using of the force mode can result in serious personal injury or damage to the equipment. Be careful when using the force mode.

11.2 The Ports page

lumbergautomation
A BELDEN BRAND

LioN-P Webserver

Home Status **Ports** System User Contact

IO-Link

Show details for port

☒ X1 ☐ X2 ☐ X3 ☐ X4 ☐ X5 ☐ X6 ☐ X7 ☐ X8

Port Information	
Port	X1
Type	IOL A
Dia	


Port Diagnosis	
Pin 2	
Function	Digital Input
State	1 bit in / NO

Pin 4	
Function	IO-Link
State	2 Bytes In, 0 Bytes Out
Pin 4 - IO-Link	
Vendor ID	317
Vendor Name	Turck
Device ID	65644
Device Name	P9010V-504-2UPN8X-H1141
Serial No.	4948484548575052565148
Description	intelligent pressure sensor
Name (Tag)	press_tank1
Input Data	27 d9
Output Data	

Detailed information about the port is shown here.

"Port Diagnosis" shows incoming and outgoing diagnoses in clear text. "Pin2" and "Pin 4" contain information about the configuration and state of the port. For IO-Link ports, additional information relating to the connected sensor and the process data is displayed.

11.3 The System page

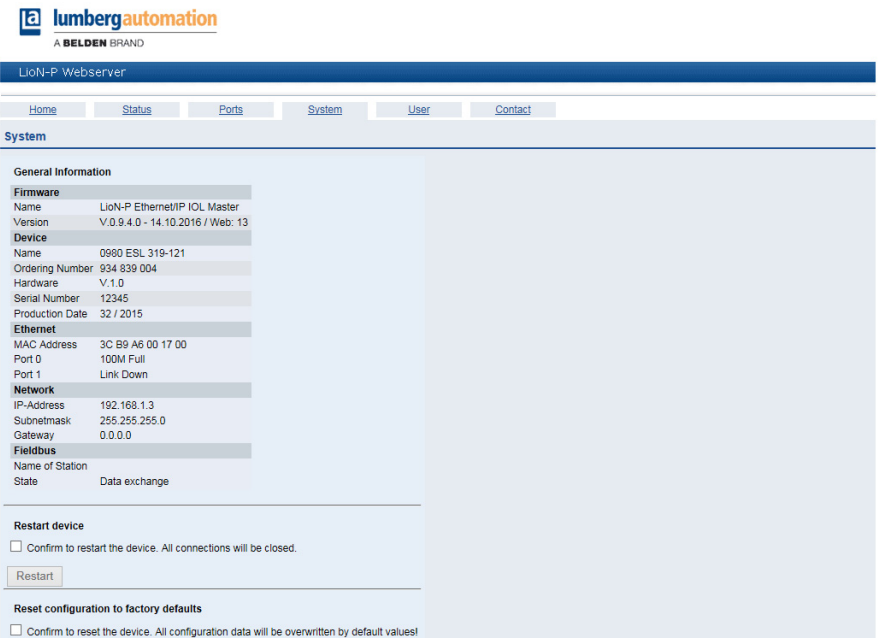

lumberg automation
A BELDEN BRAND

LioN-P Webserver

Home Status Ports System User Contact

System

General Information

Firmware	
Name	LioN-P Ethernet/IP IOL Master
Version	V.0.9.4.0 - 14.10.2016 / Web: 13
Device	
Name	0980 ESL 319-121
Ordering Number	934 839 004
Hardware	V.1.0
Serial Number	12345
Production Date	32 / 2015
Ethernet	
MAC Address	3C B9 A6 00 17 00
Port 0	100M Full
Port 1	Link Down
Network	
IP-Address	192.168.1.3
Subnetmask	255.255.255.0
Gateway	0.0.0.0
Fieldbus	
Name of Station	
State	Data exchange

Restart device

☐ Confirm to restart the device. All connections will be closed.

Reset configuration to factory defaults

☐ Confirm to reset the device. All configuration data will be overwritten by default values!

The System page shows basic information for the module. The current firmware, its version, and the firmware date can be viewed below "Firmware" as well as the version of the web interface.

All the information about the module itself is located below "Device".

For a firmware update chose the *.ZIP container provided by our website or asking our support team to send it to you. Afterwards follow the instructions.

Firmware Update


Choose file to load:

11.4 The User page

The User page provides the user management of the web interface. New users with access rights **Admin** or **Write** can be added here. For security reasons please change the default admin password immediately after configuring the device.

Default login settings:

- User name: `admin`
- Password: `private`

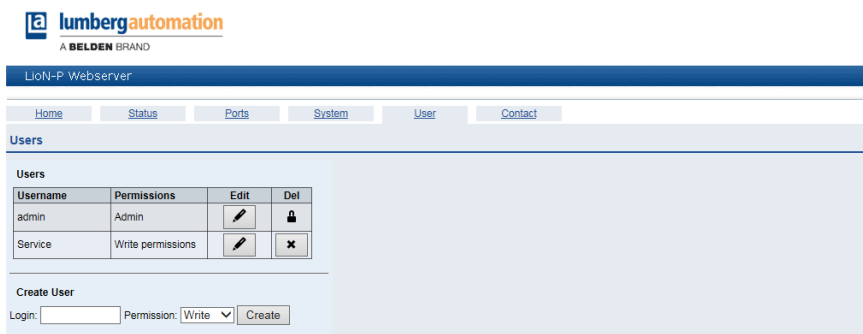

12 Technical data

12.1 General

Protection class	IP65 IP67 IP69K (This only applies if the connectors are screwed together or covers are used.) (not under UL investigation)
Ambient temperature	-20 °C to +70 °C (- 4 °F to +158 °F)
Weight (LioN-P 30)	480g
LioN-P 60	500g
Humidity	98% ambient humidity (for UL certification: 80% ambient humidity)
Housing material	Die-cast zinc
Surface finish	Matt nickel
Flammability class	UL 94 (IEC 61010)
Vibration resistance (oscillation) DIN EN 60068-2-6 (2008-11)	15 g / 5-500 Hz
Shock resistance DIN EN 60068-2-27 (2010-02)	50 g / 11 ms +/- X,Y,Z
Torques:	
M4 fixing screws	1 Nm
M4 ground connection	1 Nm
M8 connector	0.5 Nm
M12 connector	0.5 Nm

Table 87: General information

12.2 EtherNet/IP protocol

Protocol	EtherNet/IP
Update cycle	1 ms
EDS files	EDS-V3.11.1-LumbergAutomation-0980ESL199-121-yyyymmdd.eds EDS-V3.11.1-LumbergAutomation-0980ESL199-122-yyyymmdd.eds EDS-V3.11.1-LumbergAutomation-0980ESL199-331-yyyymmdd.eds EDS-V3.11.1-LumbergAutomation-0980ESL199-332-yyyymmdd.eds EDS-V3.11.1-LumbergAutomation-0980ESL398-121-yyyymmdd.eds EDS-V3.11.1-LumbergAutomation-0980ESL399-121-yyyymmdd.eds
Data transmission rate	10/100 Mbit/s, full duplex
Transmission procedure	100BASE-TX
Autonegotiation	is supported
RPI max.	1 ms
Manufacturer ID	21
Product code (number)	12
Product code (character string)	"Communications Adapter"
Product code	19902 (0980 ESL 199-121 IOL M12P MP) 19903 (0980 ESL 199-122 IOL M12P MP) 19904 (0980 ESL 199-331 IOL HYB M12 MP) 19905 (0980 ESL 199-331 IOL HYB M8 MP) 39802 (0980 ESL 398-121 IOL M12P MP) 39902 (0980 ESL 399-121 IOL M12P MP)
Supported Ethernet protocol	Ping ARP HTTP TCP/IP DHCP BOOTP DLR (beacon-based)
Switch functions	integrated
EtherNet/IP interface	2 M12 sockets
Port Autocrossing	4-pin, D-coded (see pin assignment) is supported

Table 88: Technical data EtherNet/IP

12.3 Power supply for the module electronics/sensors

Nominal voltage U_S	24 V DC (SELV/PELV)
Voltage range	18-30 V DC
Power consumption of module electronics	Typically 95 mA
Voltage level of the sensor power supply	Min. ($U_S - 1.5$ V)
Current consumption sensor system (L+ / Pin 1)	Max. 500 mA per port (at $T_U = 30$ °C) (for UL application 400 mA)
Short circuit/overload protection of sensor supply	Yes, per port
Reverse polarity protection	Yes
Operational indicator (U_S)	LED green, $18,6 \text{ V} \leq U_S \leq 30 \text{ V}$ LED red, $U_S < 18,6 \text{ V}$ or $U_S > 30 \text{ V}$
Port X03, X04 or Port X01, X02 (LioN-P 30 only)	M12 power, connector/socket, 5-pole M12 hybrid, connector/socket, 8-pole

Table 89: Information on the power supply for the module electronics/sensors

12.4 Power supply type B ports (auxiliary supply)

Rated voltage U_{Aux}	24 V DC (SELV/PELV)
Voltage range	18,6 - 30 V DC
Reverse polarity protection	Yes
Operational indicator (U_S)	LED green, $U_{Aux} > 18,6 \text{ V}$ or $U_{Aux} < 30 \text{ V}$ LED red, $U_{Aux} < 18,6 \text{ V}$ or $U_{Aux} > 30 \text{ V}$ * if "Report U_{Aux} supply voltage fault is enabled.
Port X03, X04 or Port X01, X02 (LioN-P 30 only)	M12 power, connector/socket, 5-pole M12 hybrid, connector/socket, 8-pole

Table 90: Information on the power supply for the type B ports (auxiliary supply)

12.5 IO-Link Master Ports (X1-X8, Channel A)

Port X01 – X08	M12 socket, 5-pin
or	
Port X01, X08 (LioN-P 30 only)	M8 socket, 5-pin

Table 91: Information on the power supply for the module electronics/sensors

12.5.1 Configured as a digital input

Input connection	Type 1 as per IEC 61131-2
Nominal input voltage	24 V DC
Input current	Typically 3 mA
Channel type	Normally open, p-switching
Number of digital inputs	8
Status indicator	Yellow LED
Diagnosis indicator	Red LED per channel

Table 92: Information on the inputs

12.5.2 Configured as a digital output (except 0980 ESL 3x8-121)

i NOTE

Power is supplied to the 500mA outputs via the U_S power supply.

Output type	Normally open, p-switching
Nominal output current per channel	500 mA (for UL application 400 mA)
Signal status "1"	Max. 500 mA
Signal status "0"	Max. 1 mA
Signal level of the outputs	
Signal status "1"	Min. ($U_S - 1$ V)
Signal status "0"	max. 2 V
Max. output current per device	16 A (M12 Power) (for UL application 9 A) 6 A (M12 Hybrid)
Short-circuit/overload protected	yes/yes
Behavior in case of short circuit or overload	Disconnection with automatic power on
Number of digital outputs	LioN-P 30: max. 8 (Pin 4) LioN-P 60: max. 8 (Pin 4) + 4 (Pin 2)
Status indicator	LED yellow per output
Diagnosis indicator	Red LED per channel

Table 93: IO-Link master ports configured as digital outputs

12.5.3 Configured as an IO-Link port in COM mode

IO-Link master specification	v1.1, IEC 61131-9
Communication rates	4.8 (COM 1), 38.4 (COM 2) and 230.4 kbaud (COM 3)
Line lengths in the IO-Link device	max. 20 m
Number of IO-Link ports (type A/type B)	8
Number of type A ports (X1, X2, X3, X4)	4
Number of type B ports (X5, X6, X7, X8)	4

*Table 94: As an IO-Link port in COM mode***12.6 Digital inputs (X1 – X4, type A ports, ch. B)**

Input connection	Type 1 as per IEC 61131-2
Nominal input voltage	24 V DC
Input current	Typically 3 mA
Channel type	Normally open, p-switching
Number of digital inputs	4
Status indicator	LED white
Diagnosis indicator	Red LED per channel
Port	M12 socket, 5-pin
	M8 socket, 5-pin

Table 95: Digital inputs (X1 – X4, type A ports, ch. B/pin 2)

12.7 LioN-P 60: Auxiliary power supply as digital output (X5 - X8, Type B / Ch. B)

Output type	Normally open, p-switching
0980 ESL 3x8-121	
Nominal output current per channel	1,6 A
Signal status "1"	Max. 1,6 A
Signal status "0"	Max. 1 mA
0980 ESL 3x9-121	
Nominal output current per channel	2 A (for UL application 1,8 A)
Signal status "1"	Max. 2 A
Signal status "0"	Max. 1 mA
Signal level of the outputs	
Signal status "1"	Min. ($U_{Aux} - 1\text{ V}$)
Signal status "0"	Max. 2 V
Max. output current per device	16 A (M12 Power) (for UL application 9 A) 6 A (M12 Hybrid)
Short-circuit/overload protected	Yes/Yes
Filter time in case of signal change	0 - 255 ms, default setting 80 ms
Behavior in case of short circuit or overload	Disconnection with/without automatic power on (adjustable)
Number of digital outputs	4
Status indicator	LED white per output
Diagnosis indicator	Red LED per channel

Table 96: LioN-P 60 Auxiliary power supply (X5 - X8)

Output type	Normally open, p-switching
Nominal output current per channel	2 A (for UL application 1,8 A)
Signal status "1"	Max. 2 A
Signal status "0"	Max. 1 mA
Signal level of the outputs	
Signal status "1"	Min. ($U_{Aux} - 1\text{ V}$)
Signal status "0"	max. 2 V
Max. output current per device	16 A (M12 Power) (for UL application 9 A) 6 A (M12 Hybrid)
Short-circuit/overload protected	yes/yes
Filter time in case of signal change	0 - 255 ms, default setting 80 ms
Behavior in case of short circuit or overload	Disconnection without automatic power on
Number of digital outputs	4
Status indicator	LED white per output
Diagnosis indicator	Red LED per channel

Table 97: LioN-P 60 digital 2-A outputs (X5 - X8, type B ports, ch. B/pin 2)

12.8 LEDs

U _{Aux}	Green	Auxiliary sensor/actuator voltage approx. >18,6 V ≤ U _S ≤ 30 V
	Red	Auxiliary sensor/actuator voltage approx. >18,6 V ≤ U _{Aux} ≤ 30 V * if "Report U _{Aux} supply voltage fault" is enabled.
	off	None of the above conditions
U _S	Green	System/sensor voltage approx. >18,6 V ≤ U _S ≤ 30 V
	Red	System/sensor voltage approx. >18,6 V ≤ U _{Aux} ≤ 30 V
	off	None of the above conditions
X1...X8 A	Green	IO-Link COM Mode: IO-Link communication exists
	Flashing green	IO-Link COM Mode: No IO-Link communication.
	Yellow	Standard-I/O Mode: Status of digital input or output on C/Q (pin 4 / channel A) line "high"
	off	None of the above conditions
X1...X8 B	White	Status of digital input or output on pin 2 (channel B) "high"
	Red	IO-Link COM Mode: IO-Link communication error or Overload or short circuit on C/Q (pin 4) line
	Red	All modes: Overload or short circuit on L+ (pin 1) line
	Red	SIO Mode: Overload or short circuit on C/Q (pin 4) line
	off	None of the above conditions
X01 Lnk / Act X02 Lnk / Act	Green	Ethernet connection to another subscriber. Link connection created.
	Flashing yellow	Data exchange with another subscriber.
	off	No connection to another subscriber. No link, no data exchange.
MS	Green	Device ready for operation.
	Flashing green	Device ready but not configured.
	Red	Serious error that cannot be resolved
	Flashing red	Minor error that can be resolved Example: An incorrect or contradictory configuration is classified as a minor error
	Alternately flashing red/green	The device is performing a self-test
	off	The device is switched off.

Table 98: Information of the LED colors

NS	Green	Connected: The device has at least one connection.
	Flashing green	No connection: The device has no connection. IP address exists.
	Red	Duplicate IP address: The device has detected that the assigned IP address is already being used by another device.
	Flashing red	Connection has exceeded time limit or connection interrupted.
	Alternately flashing red/green	The device is performing a self-test
	off	The device is switched off or does not have an IP address

Table 98: Information of the LED colors

13 Accessories

Item number	Description
0985 706 100/... M	Connection cable for Ethernet, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs
0985 706 101/... M	Connection cable for Ethernet, crossover, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs..
0985 706 103/... M	Connection cable for Ethernet, with M12 connector at both ends, straight, 4-pin, D-coded and RJ45 connector, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs.
0985 707 100/... M	Connection cable for Ethernet, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG PVC with blue-green casing, flexible, solid conductor/unshielded, 2 twisted wire pairs.
0985 707 101/... M	Connection cable for Ethernet, crossover, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG PVC with blue-green casing, flexible, solid conductor/unshielded, 2 twisted wire pairs.
0985 S4549 100/... M	Connection cable for Ethernet, with M12 connector at both ends, straight, 4-pin, D-coded, 26AWG PUR, halogen-free, with water-blue casing, multi-wire/shielded, 2 twisted wire pairs.
0985 S4549 103/... M	Connection cable for Ethernet, with M12 connector at both ends, straight, 4-pin, D-coded and RJ45 connector, 26AWG PUR, halogen-free, with water-blue casing, multi-wire/shielded, 2 twisted wire pairs.
0985 706 100/... M	Connection cable for PROFINET, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs.
0985 706 101/... M	Connection cable for PROFINET, crossover, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs.
0985 706 103/... M	Connection cable for PROFINET, with M12 connector at both ends, straight, 4-pin, D-coded and RJ-45 plug, 24AWG TPE with blue-green casing, highly flexible, multi-wire/unshielded, 2 twisted wire pairs.
0985 707 100/... M	Connection cable for PROFINET, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG PVC with blue-green casing, flexible, solid conductor/unshielded, 2 twisted wire pairs.
0985 707 101/... M	Connection cable for PROFINET, crossover, with M12 connector at both ends, straight, 4-pin, D-coded, 24AWG PVC with blue-green casing, flexible, solid conductor/unshielded, 2 twisted wire pairs.
0985 S4549 100/... M	Connection cable for PROFINET, with M12 connector at both ends, straight, 4-pin, D-coded, 26AWG PUR, halogen-free, with water-blue casing, multi-wire/shielded, 2 twisted wire pairs.
0985 S4549 103/... M	Connection cable for PROFINET, with M12 connector at both ends, straight, 4-pin, D-coded and RJ-45 plug, 26AWG PUR, halogen-free, with water-blue casing, multi-wire/shielded, 2 twisted wire pairs.

Table 99: Connection cables for data transfer

Item number	Description
0986 EMC 102	M12 cable connector for Ethernet cable, straight, 4-pin, D-coded, connection for spring terminal

Table 100: Connection cables for data transfer

Item number	Description
RKT 5L-726/... M	M12 Power connection cable coupling L-coded, straight, unshielded, drag chain capable PUR
RKT 5L-727/... M	M12 Power connection cable coupling L-coded, straight, unshielded, drag chain capable PUR
RKT 5L-738/... MRKT	M12 Power connection cable coupling L-coded, straight, unshielded PUR
RKTS 5L-724/... M	M12 Power connection cable coupling L-coded, straight, shielded, drag chain capable PUR
RKTS 5L-725/... M	M12 Power connection cable coupling L-coded, straight, shielded, drag chain capable PUR
RKTS 5L-737/... M	M12 Power connection cable coupling L-coded, straight, shielded PUR
RKWT 5L-726/... M	M12 Power connection cable coupling L-coded, angled, unshielded, drag chain capable PUR
RKWT 5L-727/... M	M12 Power connection cable coupling L-coded, angled, unshielded, drag chain capable PUR
RKWT 5L-738/... M	M12 Power connection cable coupling L-coded, angled, unshielded PUR
RKWTS 5L-724/... M	M12 Power connection cable coupling L-coded, angled, shielded, drag chain capable PUR
RKWTS 5L-725/... M	M12 Power connection cable coupling L-coded, angled, shielded, drag chain capable PUR
RKWTS 5L-737/... M	M12 Power connection cable coupling L-coded, angled, shielded PUR
RST 5L-726/... M	M12 Power connection cable connector L-coded, unshielded, drag chain capable PUR
RST 5L-727/... M	M12 Power connection cable connector L-coded, unshielded, drag chain capable PUR
RST 5L-738/... M	M12 Power connection cable connector L-coded, unshielded PUR
RSTS 5L-724/... M	M12 Power connection cable connector L-coded, shielded, drag chain capable PUR
RSTS 5L-725/... M	M12 Power connection cable connector L-coded, shielded, drag chain capable PUR
RSTS 5L-737/... M	M12 Power connection cable connector L-coded, shielded PUR
RSWT 5L-726/... M	M12 Power connection cable connector L-coded, unshielded, drag chain capable PUR
RSWT 5L-727/... M	M12 Power connection cable connector L-coded, unshielded, drag chain capable PUR
RSWT 5L-738/... M	M12 Power connection cable connector L-coded, unshielded PUR

Table 101: Connection cables for the power supply

Item number	Description
RSWTS 5L-724/... M	M12 Power connection cable connector L-coded, shielded, drag chain capable PUR
RSWTS 5L-725/... M	M12 Power connection cable connector L-coded, shielded, drag chain capable PUR
RSWTS 5L-737/... M	M12 Power connection cable connector L-coded, shielded PUR

Table 101: Connection cables for the power supply

Item number	Description
RKCCS 5L/11 3-6	M12 Power assembly-capable coupling L-coded, straight, shielded, cable grommet 3-6 mm, connection type Crimp
RKCCS 5L/11 5-9	M12 Power assembly-capable coupling L-coded, straight, shielded, cable grommet 5-9mm, connection type Crimp
RKCCS 5L/11 8-11	M12 Power assembly-capable coupling L-coded, straight, shielded, cable grommet 8-11mm, connection type Crimp
RKCWCS 5L/11 3-6	M12 Power assembly-capable coupling L-coded, angled, shielded, cable grommet 3-6 mm, connection type Crimp
RKCWCS 5L/11 5-9	M12 Power assembly-capable coupling L-coded, angled, shielded, cable grommet 5-9mm, connection type Crimp
RKCWCS 5L/11 8-11	M12 Power assembly-capable coupling L-coded, angled, shielded, cable grommet 8-11mm, connection type Crimp
RSCCS 5L/11 3-6	M12 Power assembly-capable connector L-coded, straight, shielded, cable grommet 3-6 mm, connection type Crimp
RSCCS 5L/11 5-9	M12 Power assembly-capable connector L-coded, straight, shielded, cable grommet 5-9mm, connection type Crimp
RSCCS 5L/11 8-11	M12 Power assembly-capable connector L-coded, straight, shielded, cable grommet 8-11mm, connection type Crimp
RSCWCS 5L/11 3-6	M12 Power assembly-capable connector L-coded, angled, shielded, cable grommet 3-6 mm, connection type Crimp
RSCWCS 5L/11 5-9	M12 Power assembly-capable connector L-coded, angled, shielded, cable grommet 5-9mm, connection type Crimp
RSCWCS 5L/11 8-11	M12 Power assembly-capable connector L-coded, angled, shielded, cable grommet 8-11mm, connection type Crimp

Table 102: Assembly-capable connectors - M12 Power

Item number	Description
	Universal screw-on type adapter
ZVK	M12 covers
ZVK Power	M12 Power covers
ZBR 9/40	Labels 60
	Labels 30

Table 103: Other accessories